


June 24, 2011

Tokyo Electric Power Company

Operation Results of Water Treatment Facility at Fukushima Daiichi Nuclear Power Station

As of 9:00am on June 24, 2011

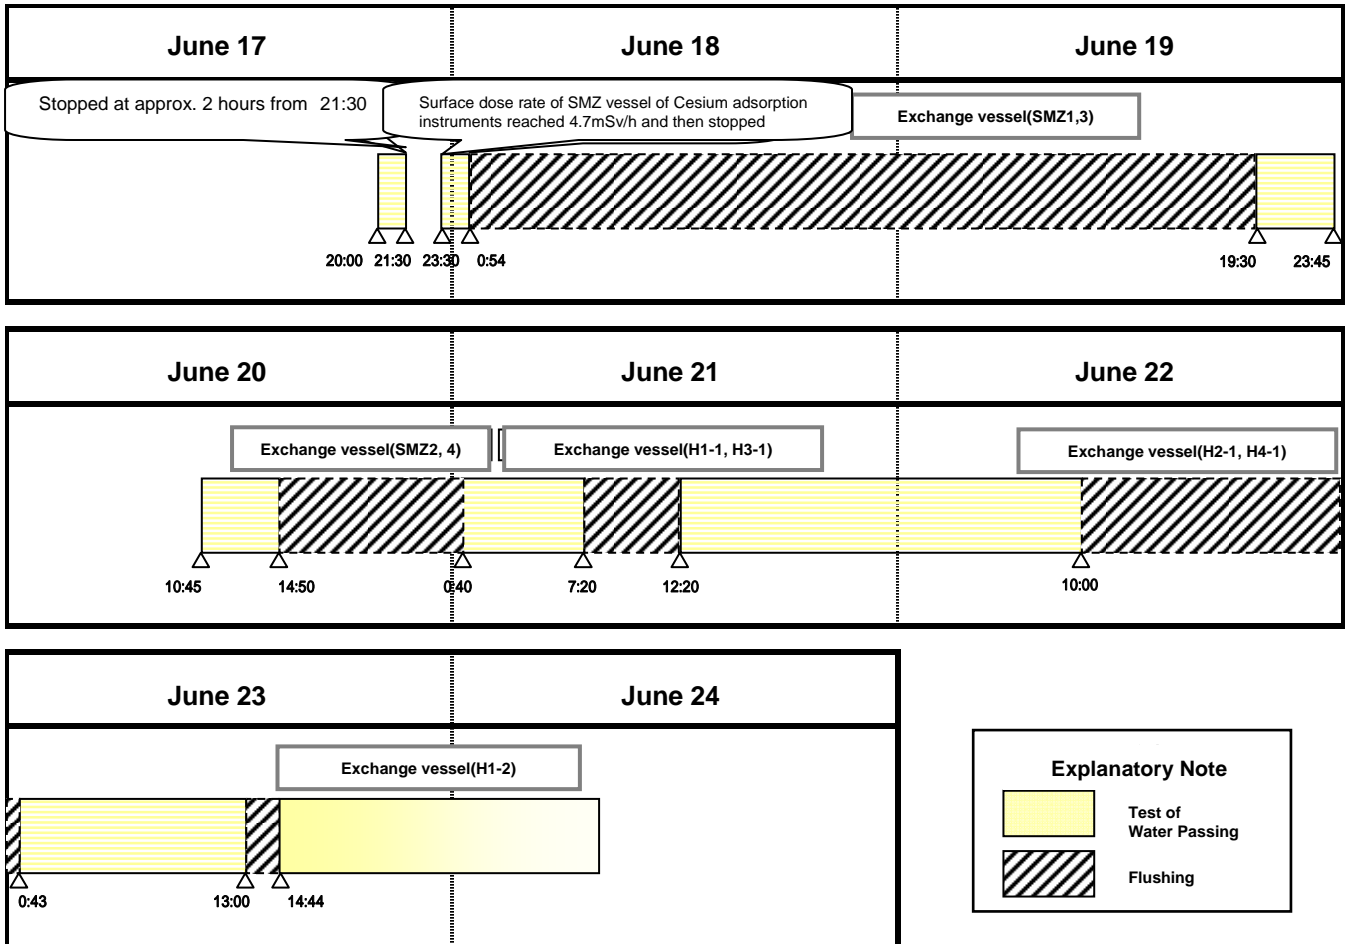

Day	Treated Hours	Operation Hours	Treated Water	Unit	Pattern of Operation
17	20:00 ~ 21:30	1 h 30 min.	Approx. 38 tons	2	SMZ(No1, 3)
	23:30 ~ 24:54	1 h 24 min.	Approx. 35 tons	2	
19	19:30 ~ 23:45	4 h 15 min.	Approx. 159 tons	3	Water (No1), SMZ(No2), Silica(No3)
20	10:45 ~ 14:50	4 h 5 min.	Approx. 204 tons	4	Water (No1), SMZ(No2, 4), Silica(No3)
21	00:40 ~ 07:20	6 h 40 min.	Approx. 333 tons	4	Water (No1, 2), Silica(No3, 4)
	12:20 ~ 10:00	21 h 40 min.	Approx. 1,083 tons	4	
23	00:43 ~ 13:00	12 h 43 min.	Approx. 636 tons	4	
	14:44 ~	Being in Operation		4	
Total		52 h 17 min.	Approx. 2,489 tons		