


Layout Temporary RHR Pumps at Unit 5

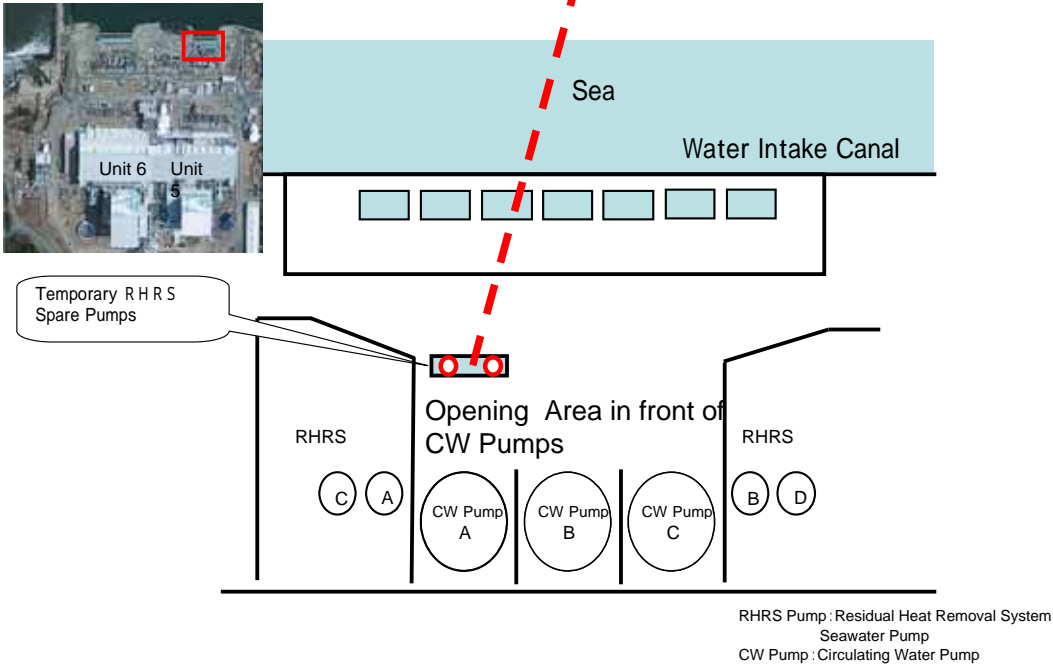

Outline of Leakage from Waterpipes of Outlet of Temporary RHR Pump at Unit 5, Fukushima Daiichi Nuclear Power Station