


### Circulating Cooling System for Spent Fuel Pool of Unit 4 in Fukushima Daiichi Nuclear Power Station Leakage of Filtered Water from Cooling Pipe of Air Fin Cooler



### Leakage Point

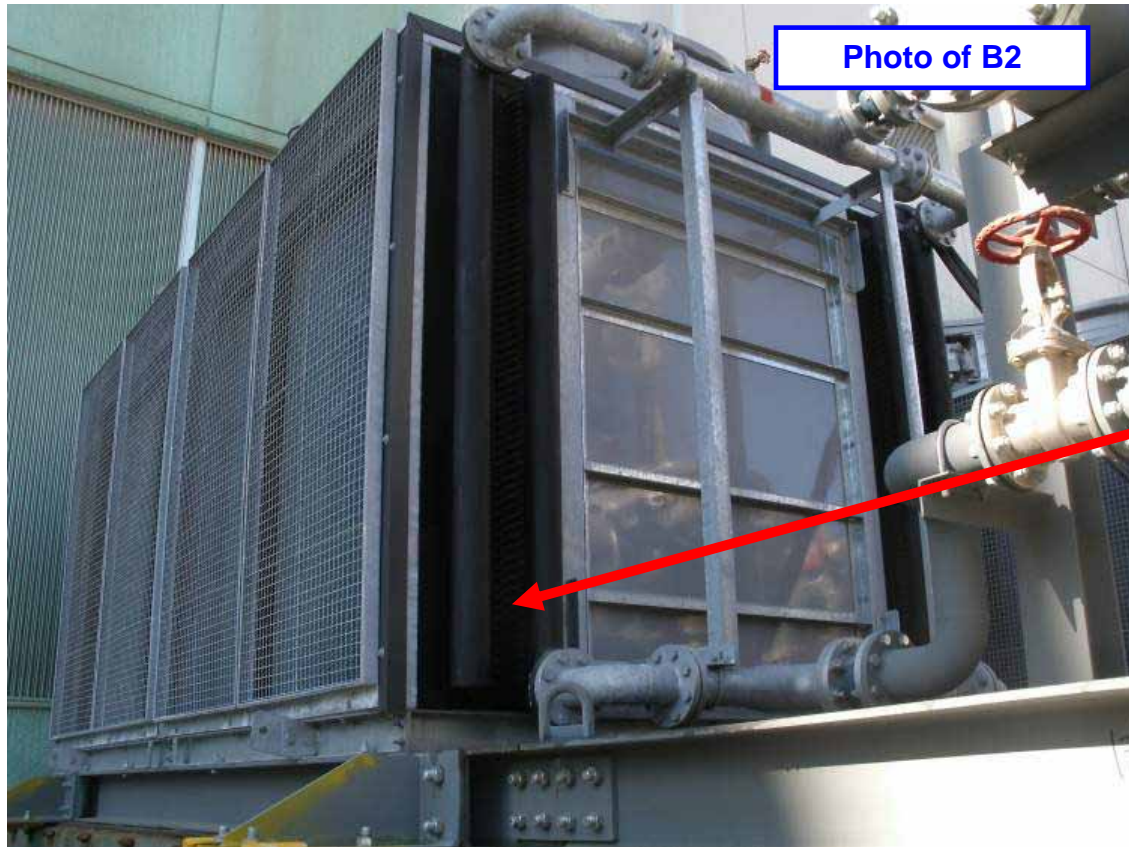

Air Fin Cooler B2: 2 points leakage  
Air Fin Cooler B3: 2 points leakage

\* There are 2 systems (System A and System B) in the secondary system of circulating cooling system for spent fuel pool. Each system has 4 air fin coolers (A1-A4, B1-B4).