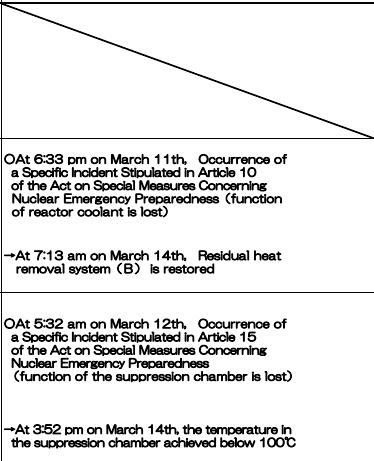
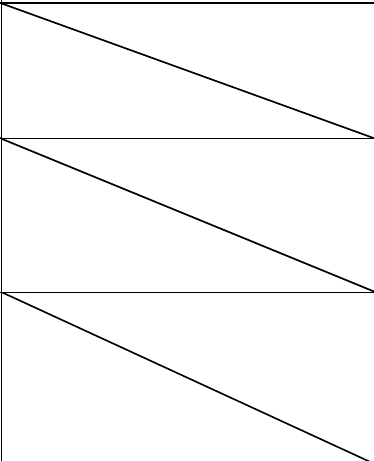
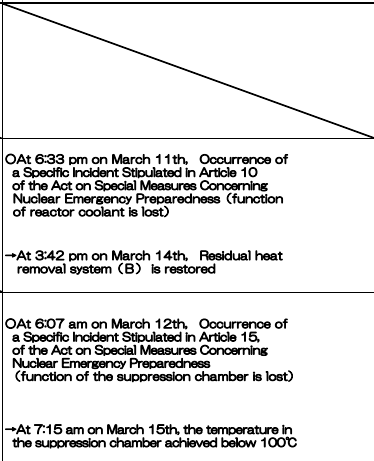


TEPCO Plant Status of Fukushima Daini Nuclear Power Station (as of 3:00 pm May 1st)

Appendix

	Unit 1	Unit 2	Unit 3	Unit 4		
Shutdown	<p>○Automatic shutdown (at 2:48 pm on March 11th)</p> <p>○All control rods are all inserted</p>	<p>○Automatic shutdown (at 2:48 pm on March 11th)</p> <p>○All control rods are all inserted</p>	<p>○Automatic shutdown (at 2:48 pm on March 11th)</p> <p>○All control rods are all inserted</p>	<p>○Automatic shutdown (at 2:48 pm on March 11th)</p> <p>○All control rods are all inserted</p>		
Cooling	<p>○Residual heat removal system (B) is in operation (From March 14th)</p> <p>※Residual heat removal system (A) was disabled due to the earthquake</p> <p>○Cold shutdown * (From March 14th)</p>	<p>○Residual heat removal system (B) is in operation (From March 14th)</p> <p>※Residual heat removal system (A) was disabled due to the earthquake</p> <p>○Cold shutdown * (From March 14th)</p>	<p>○Residual heat removal system (B) is in operation (From March 12th)</p> <p>※Residual heat removal system (A) was disabled due to the earthquake</p> <p>○Cold shutdown * (From March 12th)</p>	<p>○Residual heat removal system (B) (note) operating (From March 14th) (note) Temporarily halted due to the operation of the power switching (planned during 10:20am to 16:00pm, April 27th)</p> <p>※Residual heat removal system (A) was disabled due to the earthquake</p> <p>○Cold shutdown * (From March 15th)</p>		
Containment	<p>○No reactor coolant is leaked in the reactor containment vessel</p> <p>○Water temperature in the suppression chamber is stable (generally 30°C). (On March 14th, achieved below 100°C)</p> <p>○Containment vessel venting (measurement to decrease the pressure in the containment vessel) is not implemented</p>	<p>○No reactor coolant is leaked in the reactor containment vessel</p> <p>○Water temperature in the suppression chamber is stable (generally 30°C). (On March 14th, achieved below 100°C)</p> <p>○Containment vessel venting (measurement to decrease the pressure in the containment vessel) is not implemented</p>	<p>○No reactor coolant is leaked in the reactor containment vessel</p> <p>○Water temperature in the suppression chamber is stable (generally 30°C). (Maintain below 100°C as before the earthquake occurred)</p> <p>○Containment vessel venting (measurement to decrease the pressure in the containment vessel) is not implemented</p>	<p>○No reactor coolant is leaked in the reactor containment vessel</p> <p>○Water temperature in the suppression chamber is stable (generally 30°C). (On March 14th, achieved below 100°C)</p> <p>○Containment vessel venting (measurement to decrease the pressure in the containment vessel) is not implemented</p>		
Offsite power	Functioning	Functioning	Functioning	Functioning		
Emergency power source system	<p>○ Receiving electricity from the bus of emergency diesel generator (B) of Unit 2</p> <p>○ Receiving electricity from the bus of emergency diesel generator (B) of Unit 3</p>	<p>○ Emergency diesel generator (B) (H)</p>	<p>○ Emergency diesel generator (B) (H)</p>	<p>○ Emergency diesel generator (B) (H) (note)</p> <p>(note) Temporarily halted due to the operation of the power switching (planned during 10:20am to 16:00pm, April 27th)</p>		
Others, any reports regarding abnormal matters	<p>○At 5:35 pm on March 11th, Occurrence of a Specific Incident Stipulated in Article 10 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (reactor coolant is leaked (pressure in the reactor containment vessel increased) )</p> <p>→At 6:33 pm on March 11th, determined no reactor coolant is leaked</p>					
	<p>○At 6:33 pm on March 11th, Occurrence of a Specific Incident Stipulated in Article 10 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of reactor coolant is lost)</p> <p>→At 1:24 am on March 14th, Residual heat removal system (B) is restored</p>				<p>○At 6:33 pm on March 11th, Occurrence of a Specific Incident Stipulated in Article 10 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of reactor coolant is lost)</p> <p>→At 7:13 am on March 14th, Residual heat removal system (B) is restored</p>	<p>○At 6:33 pm on March 11th, Occurrence of a Specific Incident Stipulated in Article 10 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of reactor coolant is lost)</p> <p>→At 3:42 pm on March 14th, Residual heat removal system (B) is restored</p>
	<p>○At 5:22 am on March 12th, Occurrence of a Specific Incident Stipulated in Article 15 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of the suppression chamber is lost)</p> <p>→At 10:15 am on March 14th, the temperature in the suppression chamber achieved below 100°C</p>				<p>○At 5:32 am on March 12th, Occurrence of a Specific Incident Stipulated in Article 15 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of the suppression chamber is lost)</p> <p>→At 3:52 pm on March 14th, the temperature in the suppression chamber achieved below 100°C</p>	<p>○At 6:07 am on March 12th, Occurrence of a Specific Incident Stipulated in Article 15 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (function of the suppression chamber is lost)</p> <p>→At 7:15 am on March 15th, the temperature in the suppression chamber achieved below 100°C</p>
	<p>○At 10:07 pm on March 14th at the MP 1 and 12:12 am on March 15th at the MP 3, Occurrence of a Specific Incident Stipulated in Article 10 of the Act on Special Measures Concerning Nuclear Emergency Preparedness (Increase in radioactive material at the bound)</p> <p>→After 9:30 am April 3rd, radiation dose at the boundary of the site at Fukushima Daini Nuclear Power Station measured by MP remains below 5 μSv/h</p> <p>Regarding the result of measurement, please refer to TEPCO website at <a href="http://www.tepco.co.jp/nu/fukushima-np/">http://www.tepco.co.jp/nu/fukushima-np/</a></p>					
* : Cold shutdown . . . Achieved shutdown and maintain average water temperature below 100 °C in the Pressure Suppression Chamber.						