


Fukushima Daini Nuclear Power Station
The Result of the Dust Nuclide Analysis

Bq/cm³

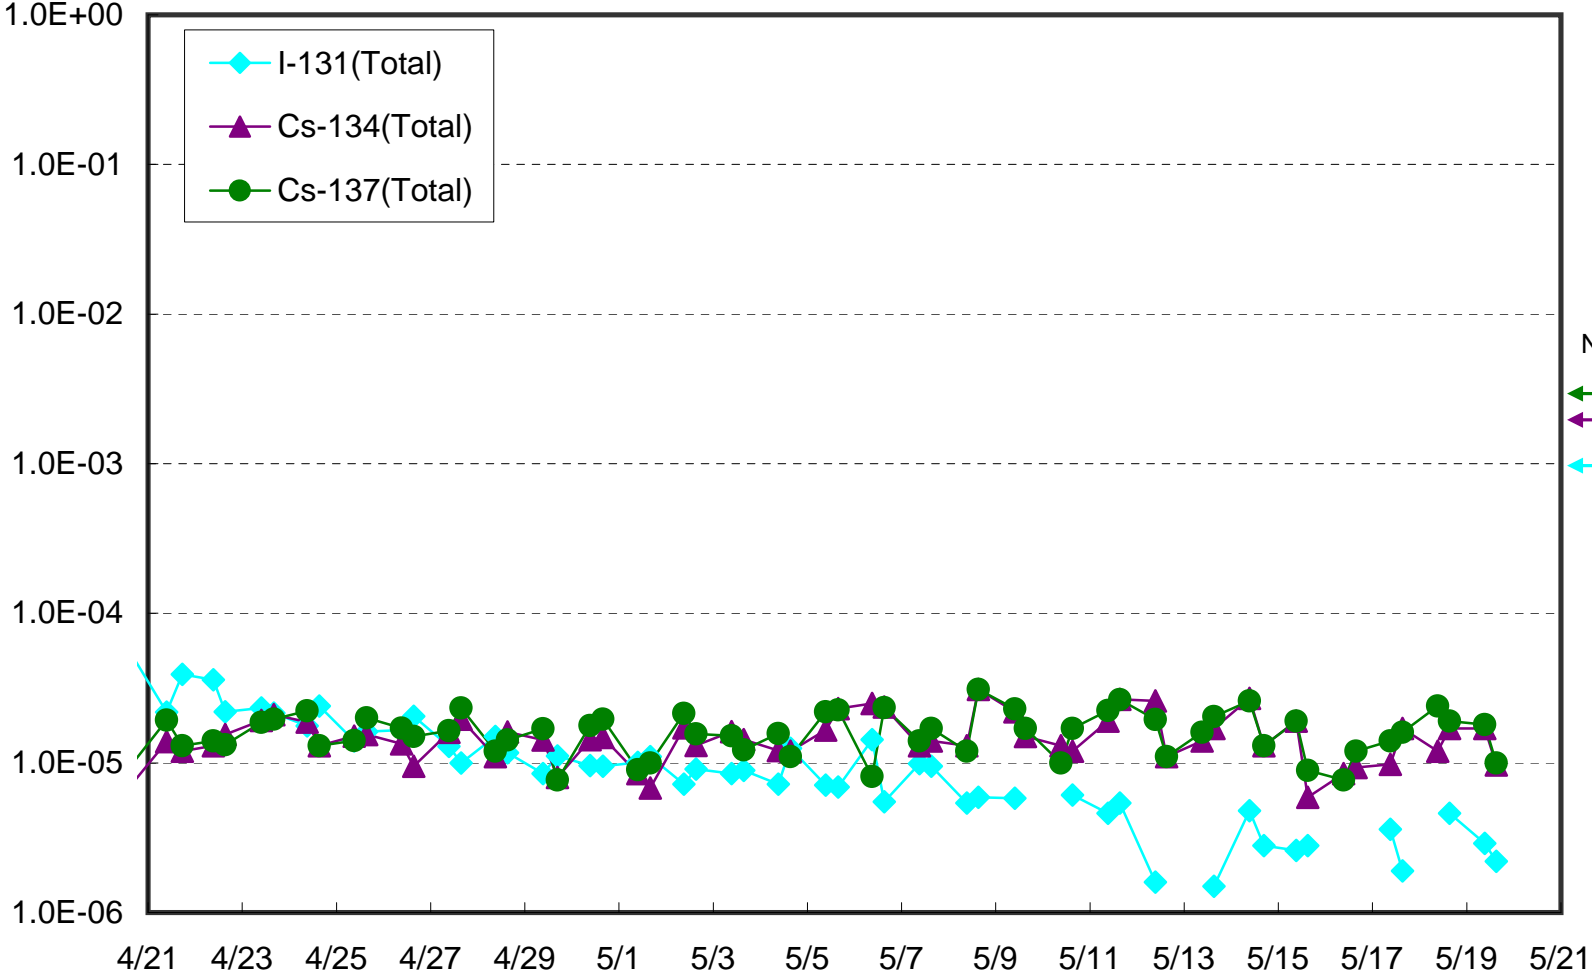

Notification

- Cs-137 (3E-3Bq/cm³)
- Cs-134 (2E-3Bq/cm³)
- I-131 (1E-3Bq/cm³)