




West Gate of Fukushima Daiichi Nuclear Power Station  
Results of Dust Nuclide Analysis (Bq/cm<sup>3</sup>)

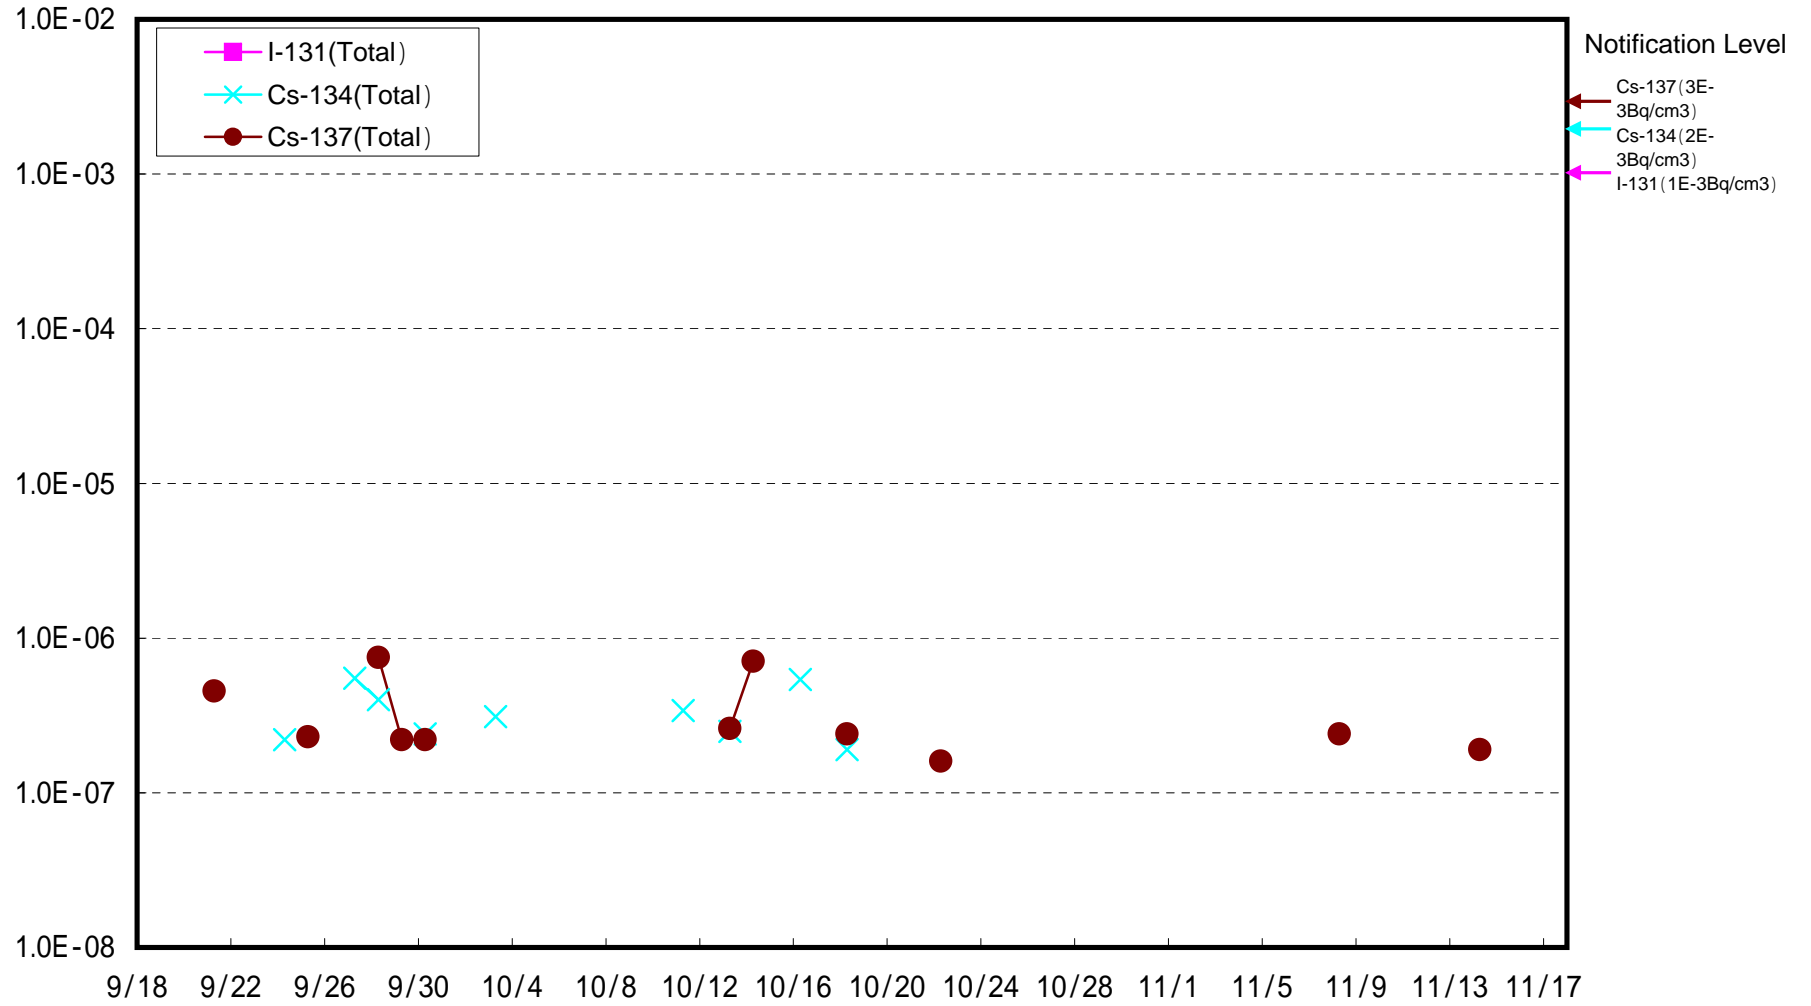

# Environment Monitoring Building of Fukushima Daiichi Results of Dust Nuclide Analysis (Bq/cm<sup>3</sup>)

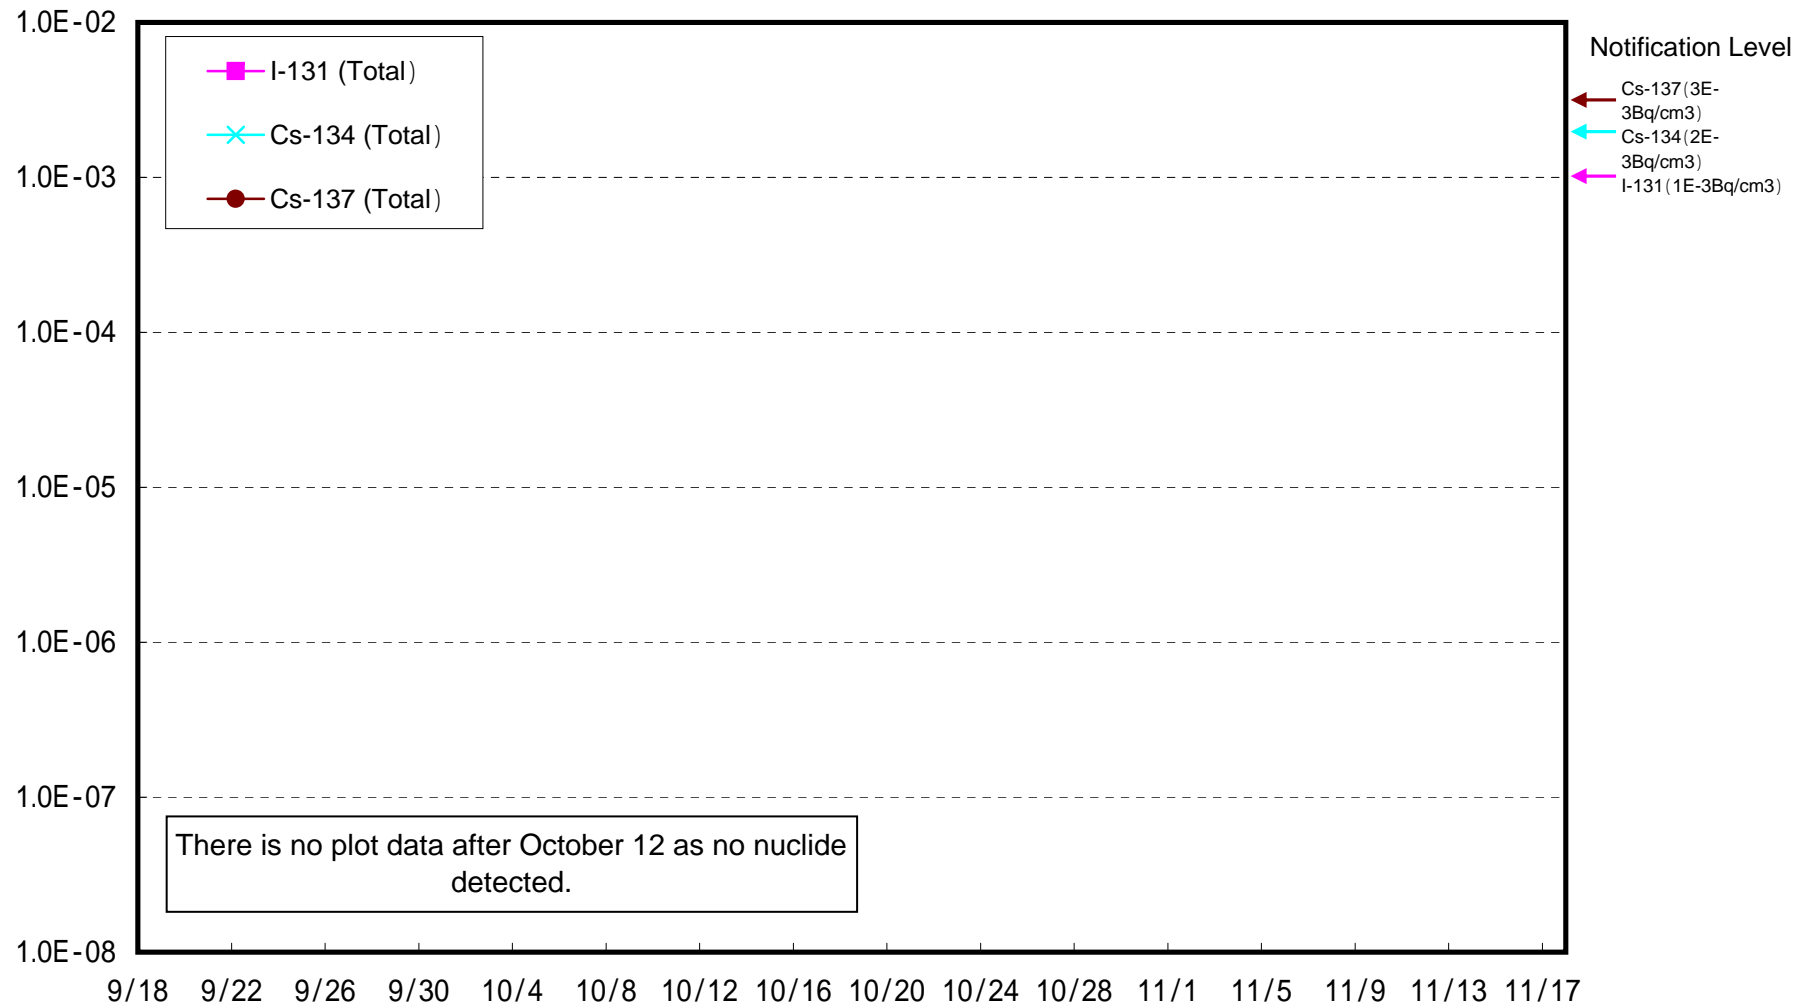

Water Treatment Building of Fukushima Daiichi Results of Dust Nuclide Analysis (Bq/cm<sup>3</sup>)

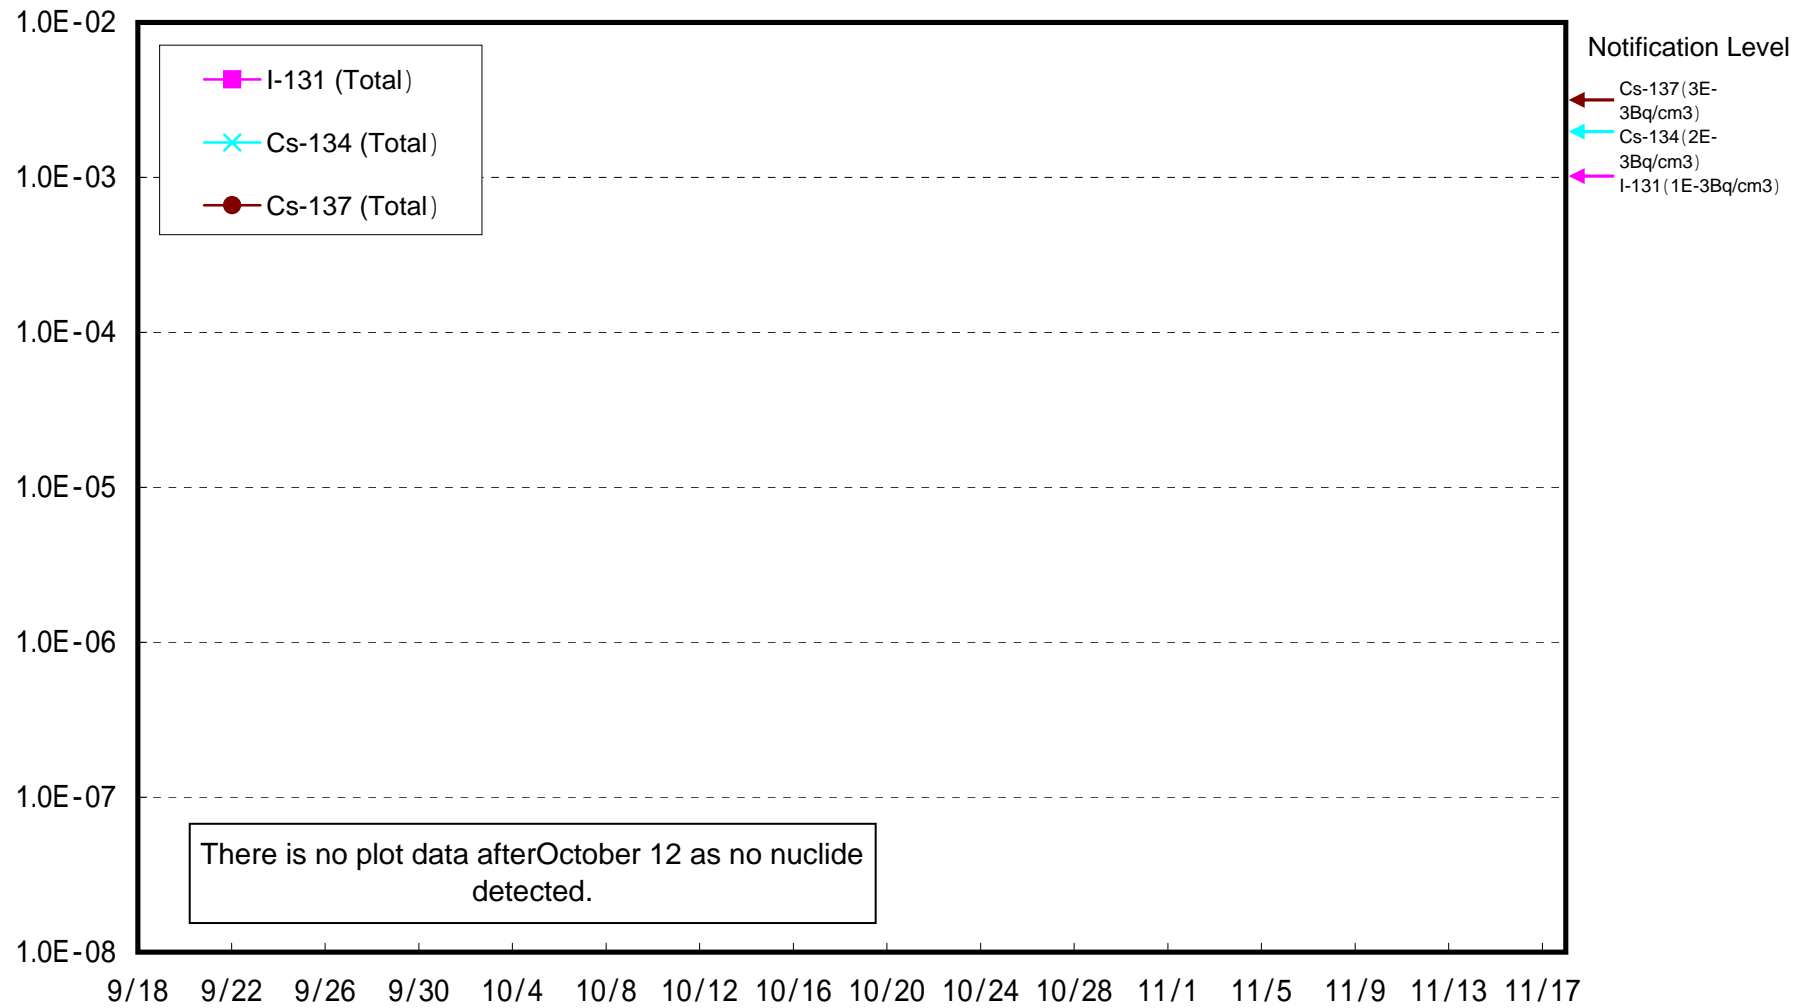

Switching Yard of Unit 5 and Unit 6, Fukushima Daiichi Results of Dust Nuclide Analysis (Bq/cm<sup>3</sup>)

