


福島第一原子力発電所 5・6号機 原子炉水温度、使用済燃料プール温度推移

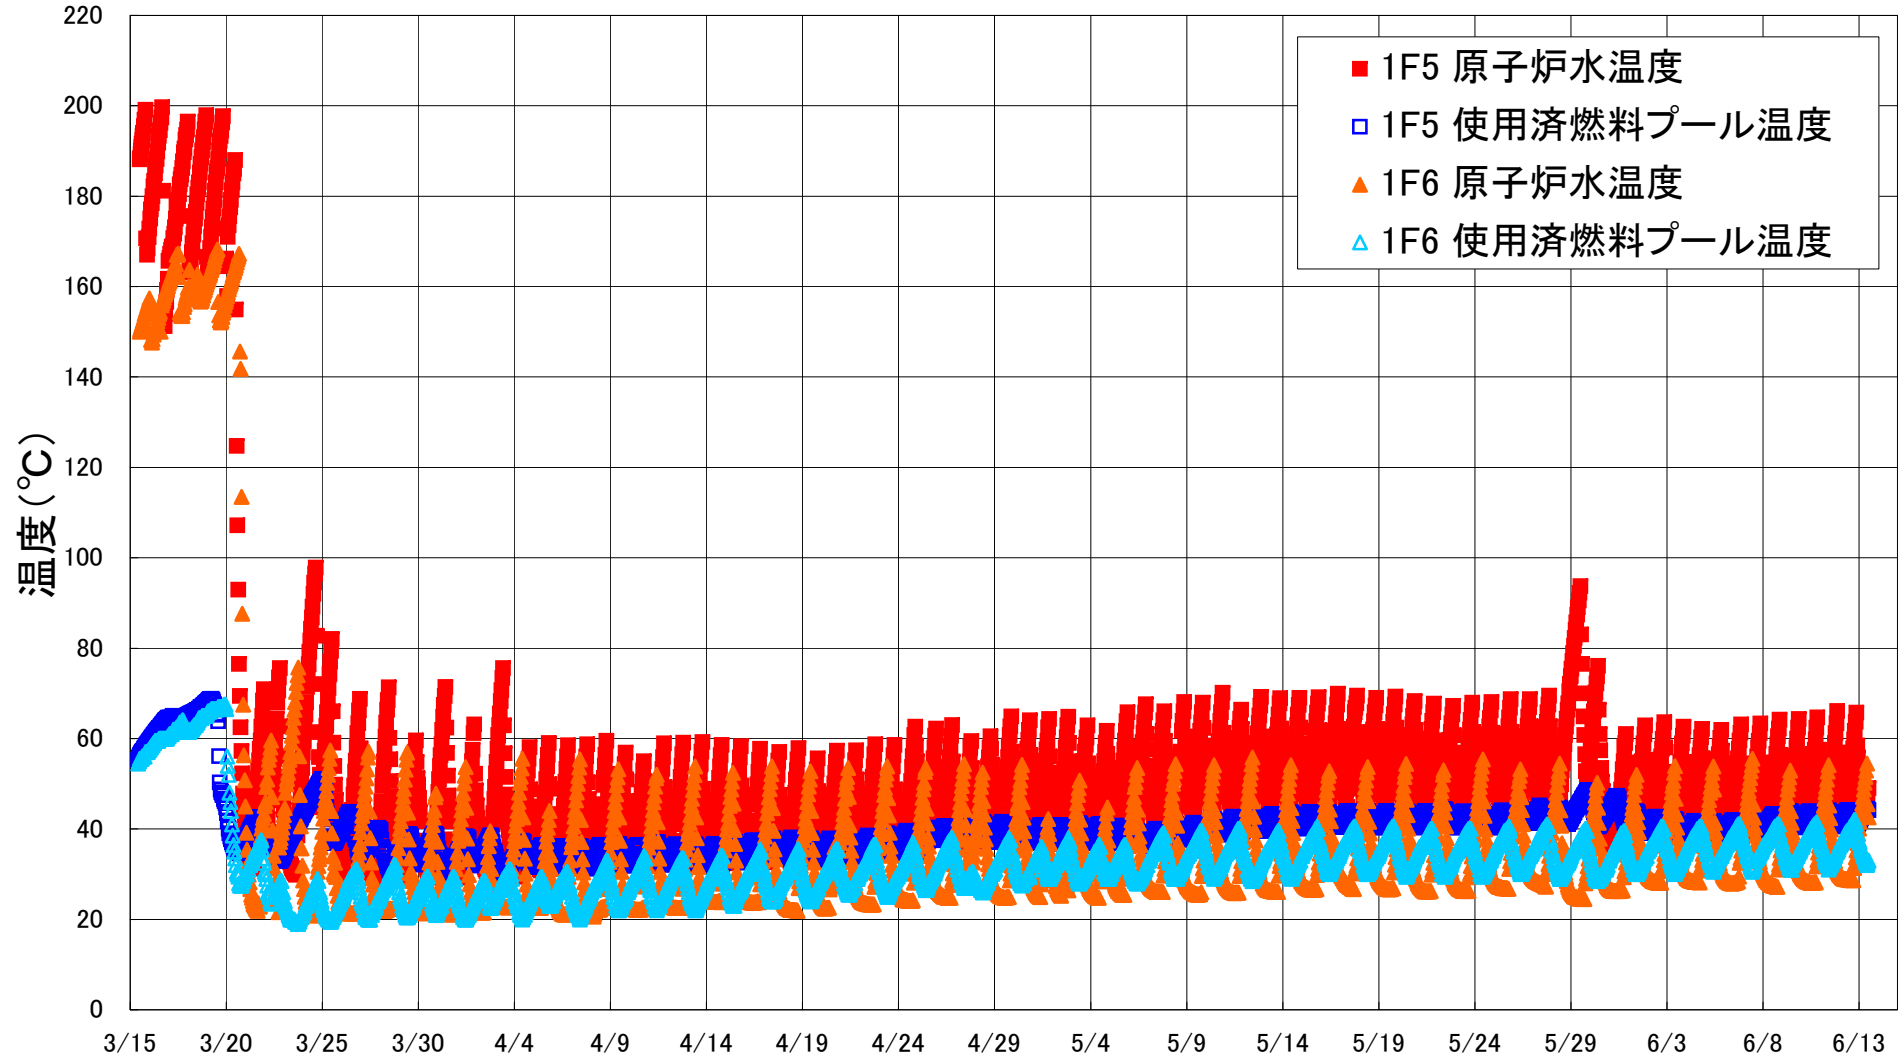

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/14 21:15	175.0	55.0	150.0	54.3
2011/3/15 10:00		55.3		54.5
2011/3/15 11:20		55.8		55.0
2011/3/15 12:00	188.1	56.1	150.0	55.5
2011/3/15 12:30	188.4	56.3	150.5	55.5
2011/3/15 13:00	189.3	56.4	150.7	55.5
2011/3/15 13:30	190.1	56.6	150.9	55.5
2011/3/15 14:00	190.9	56.7	151.3	55.5
2011/3/15 14:30	191.6	56.9	151.6	55.5
2011/3/15 15:00	192.4	57.0	151.8	56.0
2011/3/15 15:30	193.3	57.2	152.2	56.0
2011/3/15 16:00	194.0	57.3	152.5	56.0
2011/3/15 17:00	195.5	57.6	153.2	56.0
2011/3/15 18:00	196.9	57.9	153.9	56.0
2011/3/15 19:00	199.1	58.1	154.5	57.0
2011/3/15 20:00	170.6	58.5	155.0	57.0
2011/3/15 21:00	167.0	58.7	155.7	57.0
2011/3/15 22:00	168.4	58.9	156.2	57.0
2011/3/15 23:00	170.9	59.2	156.8	57.5
2011/3/16 0:00	172.8	59.5	157.4	57.5
2011/3/16 1:00	175.0	59.7	154.9	58.0
2011/3/16 2:00	177.1	60.0	148.2	58.0
2011/3/16 3:00	178.4	60.2	147.6	58.5
2011/3/16 4:00	180.0	60.4	148.3	58.5
2011/3/16 5:00	182.2	60.7	149.4	59.0
2011/3/16 6:00	183.4	60.9	149.9	59.0
2011/3/16 7:00	185.0	61.1	150.2	59.5
2011/3/16 8:00	186.8	61.4	150.9	59.5
2011/3/16 9:00	188.2	61.6	151.6	59.5
2011/3/16 10:00	189.9	61.8	152.3	59.5
2011/3/16 11:00	191.8	62.1	153.1	59.5
2011/3/16 12:00	193.4	62.3	153.9	60.0
2011/3/16 13:00	194.6	62.4	154.4	60.0
2011/3/16 14:00	196.2	62.7	150.0	60.0
2011/3/16 15:00	197.4	62.9	155.8	60.0
2011/3/16 16:00	199.7	63.2	156.3	60.0
2011/3/16 17:00	181.2	63.3	156.9	60.0
2011/3/16 18:00	153.1	63.6	157.5	60.0
2011/3/16 19:00	151.2	63.8	158.2	60.0
2011/3/16 20:00	154.0	64.1	158.6	60.0
2011/3/16 21:00	156.6	64.2	159.1	60.0
2011/3/16 22:00	159.2	64.4	159.6	60.0
2011/3/16 23:00	161.7	64.6	160.1	60.5
2011/3/17 0:00	165.7	64.6	160.7	60.5
2011/3/17 1:00	166.3	64.6	161.2	61.0
2011/3/17 2:00	167.2	64.6	161.7	61.0
2011/3/17 3:00	168.1	64.5	162.2	61.0
2011/3/17 4:00	168.8	64.5	162.7	61.0
2011/3/17 5:00	169.0	65.0	163.0	61.5
2011/3/17 6:00	170.7	64.8	163.7	62.0
2011/3/17 7:00	171.7	64.2	164.3	62.0
2011/3/17 8:00	173.1	64.2	164.9	62.0
2011/3/17 9:00	175.0	64.2	165.0	62.0
2011/3/17 10:00	178.0	64.2	167.0	62.5
2011/3/17 11:00	178.0	64.2	167.0	62.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/17 12:00	179.1	64.2	167.3	62.5
2011/3/17 13:00	180.4	64.3	162.1	63.0
2011/3/17 14:00	182.6	64.3	154.3	63.5
2011/3/17 15:00	183.7	64.4	153.8	63.5
2011/3/17 16:00	184.7	64.4	153.5	63.5
2011/3/17 17:00	186.2	64.5	153.5	64.0
2011/3/17 18:00	187.7	64.6	154.3	64.0
2011/3/17 19:00	189.7	64.7	155.5	62.5
2011/3/17 20:00	190.5	64.8	156.1	62.5
2011/3/17 21:00	192.5	64.9	157.4	62.0
2011/3/17 22:00	193.5	64.9	158.0	61.5
2011/3/17 23:00	194.7	65.1	158.7	61.5
2011/3/18 0:00	196.5	65.1	159.7	61.5
2011/3/18 1:00	175.6	65.3	160.1	61.5
2011/3/18 2:00	163.7	65.3	163.7	61.5
2011/3/18 3:00	163.1	65.5	157.1	62.0
2011/3/18 4:00	165.2	65.5	157.3	62.0
2011/3/18 5:00	167.6	65.6	158.0	62.0
2011/3/18 6:00	169.6	65.7	158.6	62.5
2011/3/18 7:00	171.5	65.8	159.2	62.5
2011/3/18 8:00	173.3	65.9	159.9	63.0
2011/3/18 9:00	175.0	66.0	160.5	63.0
2011/3/18 10:00	176.5	66.1	161.0	63.0
2011/3/18 11:00	178.5	66.2	161.8	63.5
2011/3/18 12:00	180.4	66.3	162.7	63.5
2011/3/18 13:00	181.8	66.3	161.2	64.0
2011/3/18 14:00	183.0	66.6	158.0	64.5
2011/3/18 15:00	185.2	66.6	157.7	64.5
2011/3/18 16:00	187.1	66.9	156.7	64.5
2011/3/18 17:00	188.6	66.9	156.9	64.5
2011/3/18 18:00	190.1	67.1	157.4	65.0
2011/3/18 19:00	191.8	67.3	158.0	65.0
2011/3/18 20:00	193.0	67.4	158.7	65.0
2011/3/18 21:00	194.8	67.6	159.2	65.0
2011/3/18 22:00	196.5	67.8	159.8	65.0
2011/3/18 23:00	197.9	67.9	160.4	65.0
2011/3/19 0:00	166.5	68.1	161.0	65.5
2011/3/19 1:00	163.0	68.2	161.5	66.0
2011/3/19 2:00	164.2	68.4	162.0	66.0
2011/3/19 3:00	166.5	68.6	162.5	66.0
2011/3/19 4:00	168.5	68.7	163.0	66.0
2011/3/19 5:00	171.0	68.8	163.6	66.5
2011/3/19 6:00	173.1	68.8	164.1	66.5
2011/3/19 7:00	175.3	68.5	164.6	66.5
2011/3/19 8:00	177.2	68.1	165.2	66.5
2011/3/19 9:00	179.1	67.6	165.8	66.5
2011/3/19 10:00	181.2	67.0	166.6	66.5
2011/3/19 11:00	183.0	66.6	167.2	66.5
2011/3/19 12:00	185.4	65.5	167.9	66.5
2011/3/19 13:00	186.2	65.2	168.2	66.5
2011/3/19 14:00	188.2	63.8	156.6	67.0
2011/3/19 15:00	190.1	56.1	153.6	67.0
2011/3/19 16:00	192.2	50.3	152.5	67.0
2011/3/19 17:00	193.3	48.7	152.1	67.0
2011/3/19 18:00	194.5	48.1	152.4	67.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/19 19:00	196.3	47.6	153.3	67.0
2011/3/19 20:00	197.7	47.5	154.2	67.0
2011/3/19 21:00	172.8	46.7	154.8	67.5
2011/3/19 22:00	165.5	46.2	155.8	67.5
2011/3/19 23:00	164.5	45.7	156.6	67.5
2011/3/20 0:00	166.2	44.8	157.2	66.5
2011/3/20 1:00	157.9	43.5	157.9	56.0
2011/3/20 2:00	171.0	41.7	158.7	54.0
2011/3/20 3:00	173.5	40.1	159.4	52.0
2011/3/20 4:00	175.5	39.0	160.0	48.0
2011/3/20 5:00	177.5	38.3	160.6	46.0
2011/3/20 6:00	179.2	37.7	161.1	44.0
2011/3/20 7:00	181.3	37.1	161.8	41.0
2011/3/20 8:00	183.0	36.7	162.5	38.5
2011/3/20 9:00	185.0	36.1	163.1	36.5
2011/3/20 10:00	186.0	35.7	163.5	35.0
2011/3/20 11:00	188.0	35.1	164.1	33.5
2011/3/20 12:00	154.9	35.3	164.7	32.0
2011/3/20 13:00	124.7	35.2	165.3	30.5
2011/3/20 14:00	107.2	35.2	166.0	30.0
2011/3/20 15:00	92.9	35.2	166.6	29.5
2011/3/20 16:00	76.5	35.1	167.2	28.0
2011/3/20 17:00	69.4	34.6	145.6	27.5
2011/3/20 18:00	62.5	34.9	141.8	27.5
2011/3/20 19:00	57.2	35.3	113.5	27.5
2011/3/20 20:00	52.3	35.7	87.6	28.0
2011/3/20 21:00	47.8	36.3	67.5	28.5
2011/3/20 22:00	44.8	36.7	56.3	29.0
2011/3/20 23:00	43.0	37.0	50.8	29.5
2011/3/21 0:00	41.2	37.3	45.0	30.0
2011/3/21 1:00	39.0	37.9	39.2	30.0
2011/3/21 2:00	37.6	38.3	35.4	30.0
2011/3/21 3:00	36.3	38.6	32.3	31.0
2011/3/21 4:00	35.2	39.1	29.9	31.0
2011/3/21 5:00	34.4	39.5	28.2	32.0
2011/3/21 6:00	33.6	39.9	26.7	32.0
2011/3/21 7:00	32.9	40.2	25.4	32.5
2011/3/21 8:00	32.4	40.6	24.8	33.0
2011/3/21 9:00	32.0	41.0	24.1	33.5
2011/3/21 10:00	31.5	41.5	23.4	34.0
2011/3/21 11:00	31.2	41.9	23.1	34.0
2011/3/21 12:00	45.0	42.2	22.8	35.0
2011/3/21 13:00	47.0	42.6	22.4	35.0
2011/3/21 14:00	49.1	42.6	22.2	35.5
2011/3/21 15:00	51.2	42.6	21.9	36.0
2011/3/21 16:00	53.2	42.3	23.6	36.0
2011/3/21 17:00	55.2	42.3	23.0	36.5
2011/3/21 18:00	57.7	42.1	22.8	37.0
2011/3/21 19:00	59.6	39.7	38.2	37.5
2011/3/21 20:00	62.6	37.8	40.1	37.5
2011/3/21 21:00	65.0	37.0	41.2	35.5
2011/3/21 22:00	68.4	36.4	42.4	33.5
2011/3/21 23:00	70.9	36.1	43.3	32.5
2011/3/22 0:00	57.9	35.9	45.1	30.5
2011/3/22 1:00	53.9	35.8	46.0	30.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/22 2:00	49.3	35.7	49.3	29.0
2011/3/22 3:00	45.0	35.7	50.9	27.5
2011/3/22 4:00	42.2	36.0	53.6	26.0
2011/3/22 5:00	39.3	36.3	55.3	25.5
2011/3/22 6:00	38.2	36.7	56.5	25.0
2011/3/22 7:00	36.7	37.1	58.0	24.0
2011/3/22 8:00	46.3	37.4	59.6	23.5
2011/3/22 9:00	48.6	37.7	47.0	23.5
2011/3/22 10:00	51.0	37.6	39.7	24.0
2011/3/22 11:00	53.2	37.5	34.1	25.0
2011/3/22 12:00	55.5	37.4	31.3	25.5
2011/3/22 13:00	58.4	37.3	28.3	26.0
2011/3/22 14:00	61.7	36.9	26.5	26.0
2011/3/22 15:00	64.4	35.5	24.3	26.5
2011/3/22 16:00	67.9	34.1	23.9	27.0
2011/3/22 17:00	70.6	33.5	21.6	27.5
2011/3/22 18:00	73.5	33.3	35.9	28.0
2011/3/22 19:00	75.6	33.1	37.1	28.5
2011/3/22 20:00	62.7	32.9	38.0	28.5
2011/3/22 21:00	56.1	33.2	39.2	28.5
2011/3/22 22:00	51.6	33.5	40.3	26.5
2011/3/22 23:00	47.7	33.8	41.7	26.0
2011/3/23 0:00	44.3	34.2	43.1	24.5
2011/3/23 1:00	41.8	34.6	44.6	24.0
2011/3/23 2:00	39.3	35.1	48.0	23.0
2011/3/23 3:00	37.8	35.4	49.9	22.5
2011/3/23 4:00	36.6	35.7	51.1	22.0
2011/3/23 5:00	35.3	36.2	52.4	21.5
2011/3/23 6:00	34.2	36.6	54.0	21.0
2011/3/23 7:00	33.4	36.9	55.3	20.5
2011/3/23 8:00	32.6	37.3	57.0	20.0
2011/3/23 9:00	31.9	37.8	59.1	20.0
2011/3/23 10:00	31.4	38.1	60.6	20.0
2011/3/23 11:00	31.1	38.6	62.5	20.0
2011/3/23 12:00	30.7	39.0	64.6	20.0
2011/3/23 13:00	30.4	39.3	66.4	20.0
2011/3/23 14:00	30.2	39.6	68.1	19.5
2011/3/23 15:00	29.9	40.1	70.3	19.5
2011/3/23 16:00	29.9	40.3	72.3	19.5
2011/3/23 17:00	38.5	40.7	74.0	19.0
2011/3/23 18:00	40.9	41.1	75.7	19.0
2011/3/23 19:00	43.1	41.5	56.1	19.5
2011/3/23 20:00	45.4	41.8	47.5	20.0
2011/3/23 21:00	47.8	42.2	40.6	20.5
2011/3/23 22:00	50.7	42.6	35.7	20.5
2011/3/23 23:00	53.5	43.0	31.9	21.0
2011/3/24 0:00	56.9	43.2	28.6	21.5
2011/3/24 1:00	59.4	43.6	26.7	21.5
2011/3/24 2:00	62.7	44.0	25.0	22.0
2011/3/24 3:00	65.3	44.3	23.9	23.0
2011/3/24 4:00	68.0	44.6	23.3	23.0
2011/3/24 5:00	71.4	45.1	24.1	23.5
2011/3/24 6:00	73.5	45.4	24.2	24.0
2011/3/24 7:00	76.4	45.7	24.3	24.0
2011/3/24 8:00	79.2	46.1	24.3	24.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/24 9:00	81.7	46.4	24.3	25.0
2011/3/24 10:00	84.3	46.9	24.4	25.5
2011/3/24 11:00	86.8	47.2	24.4	26.0
2011/3/24 12:00	89.2	47.5	23.8	26.5
2011/3/24 13:00	92.0	47.7	22.3	27.0
2011/3/24 14:00	94.5	48.1	21.5	27.0
2011/3/24 15:00	96.5	48.4	21.2	27.5
2011/3/24 16:00	97.8	48.7	20.8	28.0
2011/3/24 17:00	82.7	49.0	21.3	28.5
2011/3/24 18:00	72.0	49.4	30.5	29.0
2011/3/24 19:00	61.4	49.8	31.8	28.5
2011/3/24 20:00	55.9	50.1	33.3	26.5
2011/3/24 21:00	52.0	50.3	34.5	26.0
2011/3/24 22:00	47.8	50.6	35.9	25.0
2011/3/24 23:00	44.8	50.9	37.1	24.0
2011/3/25 0:00	48.8	51.1	39.4	23.0
2011/3/25 1:00	51.4	50.9	42.3	22.5
2011/3/25 2:00	54.3	50.6	44.0	22.0
2011/3/25 3:00	57.3	50.2	45.5	21.5
2011/3/25 4:00	59.9	49.4	46.8	21.0
2011/3/25 5:00	62.8	45.2	48.4	20.5
2011/3/25 6:00	65.8	43.4	50.2	20.5
2011/3/25 7:00	68.9	42.6	52.0	20.0
2011/3/25 8:00	71.2	42.1	53.5	20.0
2011/3/25 9:00	74.3	40.9	55.5	20.0
2011/3/25 10:00	77.0	39.5	57.4	19.5
2011/3/25 11:00	79.4	38.3	44.0	19.5
2011/3/25 12:00	82.0	37.5	39.0	20.0
2011/3/25 13:00	66.0	37.1	33.9	20.5
2011/3/25 14:00	59.1	37.0	30.4	20.5
2011/3/25 15:00	53.9	36.9	29.9	21.0
2011/3/25 16:00	49.8	37.2	32.5	21.5
2011/3/25 17:00	46.4	37.5	29.4	22.0
2011/3/25 18:00	43.2	37.9	26.9	22.0
2011/3/25 19:00	40.7	38.3	25.2	22.5
2011/3/25 20:00	38.6	38.8	23.8	23.0
2011/3/25 21:00	37.1	39.0	22.9	23.5
2011/3/25 22:00	35.5	39.4	23.0	23.5
2011/3/25 23:00	34.5	39.8	27.6	24.0
2011/3/26 0:00	33.6	40.1	27.3	24.5
2011/3/26 1:00	32.8	40.5	26.2	24.5
2011/3/26 2:00	32.1	40.9	25.0	25.0
2011/3/26 3:00	31.6	41.2	24.1	25.5
2011/3/26 4:00	31.1	41.6	23.2	26.0
2011/3/26 5:00	30.6	42.0	22.6	26.5
2011/3/26 6:00	30.3	42.3	22.1	27.0
2011/3/26 7:00	30.0	42.9	21.7	27.5
2011/3/26 8:00	29.7	43.0	21.4	28.0
2011/3/26 9:00	29.4	43.4	21.3	28.0
2011/3/26 10:00	34.3	43.8	21.4	29.0
2011/3/26 11:00	36.5	43.7	21.3	29.0
2011/3/26 12:00	39.7	43.5	21.4	29.5
2011/3/26 13:00	44.2	43.2	21.3	29.5
2011/3/26 14:00	43.8	42.8	21.3	30.0
2011/3/26 15:00	47.6	39.5	21.4	30.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/26 16:00	49.6	38.6	21.4	30.5
2011/3/26 17:00	52.7	38.1	21.4	30.5
2011/3/26 18:00	55.1	37.7	29.4	31.0
2011/3/26 19:00	58.0	36.7	30.6	31.0
2011/3/26 20:00	61.2	35.6	32.1	29.5
2011/3/26 21:00	63.4	34.8	33.3	28.5
2011/3/26 22:00	66.2	34.1	34.8	27.0
2011/3/26 23:00	68.8	33.6	36.6	26.0
2011/3/27 0:00	57.8	33.2	39.3	25.0
2011/3/27 1:00	52.5	33.0	41.2	24.0
2011/3/27 2:00	48.0	33.2	42.9	23.5
2011/3/27 3:00	44.9	33.4	44.4	23.0
2011/3/27 4:00	41.6	33.9	46.3	22.0
2011/3/27 5:00	39.6	34.2	47.8	21.0
2011/3/27 6:00	37.6	34.6	49.4	20.5
2011/3/27 7:00	36.1	34.9	51.2	20.5
2011/3/27 8:00	34.8	35.3	53.2	20.5
2011/3/27 9:00	33.3	35.8	55.8	20.0
2011/3/27 10:00	32.6	36.1	57.1	20.0
2011/3/27 11:00	31.9	36.5	43.9	20.0
2011/3/27 12:00	31.3	36.8	38.0	20.0
2011/3/27 13:00	30.7	37.4	32.6	21.0
2011/3/27 14:00	30.3	37.8	29.1	21.0
2011/3/27 15:00	30.0	38.0	27.7	21.5
2011/3/27 16:00	29.7	38.4	25.8	22.0
2011/3/27 17:00	29.5	38.8	24.9	22.5
2011/3/27 18:00	29.3	39.1	24.3	22.5
2011/3/27 19:00	29.1	39.5	23.8	23.0
2011/3/27 20:00	28.9	39.9	23.3	24.0
2011/3/27 21:00	32.7	40.2	23.1	24.0
2011/3/27 22:00	35.3	40.2	22.8	24.0
2011/3/27 23:00	38.1	40.0	22.6	24.5
2011/3/28 0:00	39.9	39.9	22.5	25.0
2011/3/28 1:00	43.1	39.7	22.3	25.5
2011/3/28 2:00	46.1	37.5	22.2	26.0
2011/3/28 3:00	49.5	36.0	22.0	26.5
2011/3/28 4:00	51.9	35.5	22.0	26.5
2011/3/28 5:00	54.9	35.1	22.0	27.0
2011/3/28 6:00	57.7	34.5	21.9	27.5
2011/3/28 7:00	60.4	33.7	22.0	28.0
2011/3/28 8:00	63.5	32.9	22.1	28.0
2011/3/28 9:00	66.4	32.3	22.2	28.5
2011/3/28 10:00	68.5	31.7	22.3	29.0
2011/3/28 11:00	71.3	31.2	22.4	29.5
2011/3/28 12:00	60.1	30.9	22.4	30.0
2011/3/28 13:00	55.4	30.7	22.4	30.0
2011/3/28 14:00	50.6	30.9	22.3	30.5
2011/3/28 15:00	47.1	31.3	22.3	30.5
2011/3/28 16:00	44.3	31.6	22.4	31.0
2011/3/28 17:00	41.4	32.1	22.4	31.5
2011/3/28 18:00	39.5	32.5	22.4	32.0
2011/3/28 19:00	37.8	32.8	29.1	32.0
2011/3/28 20:00	36.4	33.3	30.3	31.0
2011/3/28 21:00	35.1	33.7	32.0	29.0
2011/3/28 22:00	34.2	33.9	33.7	28.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/28 23:00	33.2	34.4	35.8	27.0
2011/3/29 0:00	32.5	34.8	38.4	26.0
2011/3/29 1:00	32.0	35.1	40.0	25.0
2011/3/29 2:00	31.4	35.5	41.7	24.5
2011/3/29 3:00	30.9	35.9	43.4	24.0
2011/3/29 4:00	30.4	36.3	45.3	23.0
2011/3/29 5:00	30.1	36.8	47.2	22.5
2011/3/29 6:00	29.8	37.1	48.9	22.0
2011/3/29 7:00	29.0	37.4	50.9	21.5
2011/3/29 8:00	29.3	37.8	53.1	21.0
2011/3/29 9:00	29.1	38.3	55.3	20.5
2011/3/29 10:00	29.0	38.5	56.9	20.5
2011/3/29 11:00	32.5	38.9	43.6	20.5
2011/3/29 12:00	35.0	38.8	37.7	21.0
2011/3/29 13:00	37.5	38.8	33.5	21.0
2011/3/29 14:00	40.5	38.6	30.3	21.5
2011/3/29 15:00	43.4	38.4	28.9	22.0
2011/3/29 16:00	46.3	37.5	30.1	22.5
2011/3/29 17:00	48.9	35.5	28.5	22.5
2011/3/29 18:00	51.8	34.5	27.1	23.0
2011/3/29 19:00	54.2	34.2	26.1	23.5
2011/3/29 20:00	57.1	33.9	25.1	24.0
2011/3/29 21:00	59.6	33.4	24.4	24.5
2011/3/29 22:00	54.8	32.6	23.8	24.5
2011/3/29 23:00	51.2	32.4	23.3	25.0
2011/3/30 0:00	49.8	32.1	22.9	25.5
2011/3/30 1:00	46.8	32.4	22.6	26.0
2011/3/30 2:00	43.7	32.7	22.2	26.5
2011/3/30 3:00	41.7	33.0	22.1	27.0
2011/3/30 4:00	37.4	33.4	21.8	27.0
2011/3/30 5:00	35.9	33.7	21.7	27.5
2011/3/30 6:00	34.7	34.2	21.6	28.0
2011/3/30 7:00	33.7	34.5	21.5	28.5
2011/3/30 8:00	32.8	34.9	21.4	28.5
2011/3/30 9:00	32.0	35.3	21.3	29.0
2011/3/30 10:00	31.5	35.7	27.2	29.0
2011/3/30 11:00	31.0	36.1	28.2	29.5
2011/3/30 12:00	30.6	36.5	29.5	29.5
2011/3/30 13:00	30.2	36.8	30.9	27.0
2011/3/30 14:00	29.9	37.2	32.6	26.5
2011/3/30 15:00	29.7	37.5	34.7	25.5
2011/3/30 16:00	29.4	37.9	37.6	24.5
2011/3/30 17:00	29.3	38.3	39.2	23.5
2011/3/30 18:00	29.2	38.7	40.9	23.0
2011/3/30 19:00	31.6	39.0	42.5	22.5
2011/3/30 20:00	33.7	39.0	44.2	22.0
2011/3/30 21:00	38.3	38.8	47.0	21.5
2011/3/30 22:00	39.4	38.8	47.8	21.0
2011/3/30 23:00	42.3	38.5	37.2	21.0
2011/3/31 0:00	45.4	37.2	32.7	21.5
2011/3/31 1:00	48.2	35.6	29.6	22.0
2011/3/31 2:00	51.0	34.6	27.1	22.5
2011/3/31 3:00	53.9	34.2	25.4	22.5
2011/3/31 4:00	56.3	33.9	26.9	23.0
2011/3/31 5:00	58.7	33.3	27.7	23.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/3/31 6:00	61.9	32.4	26.0	24.0
2011/3/31 7:00	64.8	31.7	24.8	24.5
2011/3/31 8:00	67.4	31.2	23.8	25.0
2011/3/31 9:00	69.4	30.8	23.3	25.0
2011/3/31 10:00	71.4	30.4	22.9	25.5
2011/3/31 11:00	62.4	30.0	22.3	26.0
2011/3/31 12:00	56.8	29.9	22.0	26.5
2011/3/31 13:00	51.8	30.2	21.7	27.0
2011/3/31 14:00	47.4	30.6	21.4	27.0
2011/3/31 15:00	44.4	30.9	21.3	27.5
2011/3/31 16:00	41.8	31.2	21.2	28.0
2011/3/31 17:00	41.7	31.7	21.1	28.5
2011/3/31 18:00	37.7	32.0	21.1	29.0
2011/3/31 19:00	36.3	32.4	21.1	29.0
2011/3/31 20:00	34.9	33.0	26.9	29.5
2011/3/31 21:00	34.0	33.3	27.6	29.0
2011/3/31 22:00	33.3	33.6	28.8	29.0
2011/3/31 23:00	32.4	34.0	31.1	27.0
2011/4/1 0:00	31.9	34.3	32.7	26.0
2011/4/1 1:00	31.4	34.7	34.8	25.0
2011/4/1 2:00	30.9	35.1	37.4	24.0
2011/4/1 3:00	30.6	35.5	39.1	23.5
2011/4/1 4:00	30.3	35.8	40.6	23.0
2011/4/1 5:00	30.0	36.2	42.2	22.5
2011/4/1 6:00	29.8	36.6	44.1	22.0
2011/4/1 7:00	29.6	37.0	45.8	21.0
2011/4/1 8:00	29.5	37.3	47.9	20.5
2011/4/1 9:00	29.3	37.8	50.1	20.5
2011/4/1 10:00	29.2	38.2	51.8	20.0
2011/4/1 11:00	32.1	38.2	53.7	20.0
2011/4/1 12:00	34.5	38.4	44.7	20.0
2011/4/1 13:00	37.8	38.2	37.9	20.5
2011/4/1 14:00	40.9	38.1	33.3	21.0
2011/4/1 15:00	44.2	37.8	29.8	21.0
2011/4/1 16:00	46.7	35.9	27.7	21.5
2011/4/1 17:00	49.5	34.8	26.0	22.0
2011/4/1 18:00	52.3	34.4	24.6	22.5
2011/4/1 19:00	55.0	34.0	23.5	22.5
2011/4/1 20:00	57.5	33.6	22.4	23.0
2011/4/1 21:00	61.2	32.6	21.9	23.5
2011/4/1 22:00	63.1	32.1	22.0	24.0
2011/4/1 23:00	52.2	31.9	22.1	24.5
2011/4/2 0:00	48.5	32.0	22.1	24.5
2011/4/2 1:00	45.2	32.3	22.0	25.0
2011/4/2 2:00	42.4	32.6	22.0	25.5
2011/4/2 3:00	40.0	33.0	21.9	26.0
2011/4/2 4:00	38.0	33.3	21.8	26.0
2011/4/2 5:00	36.7	33.7	21.7	26.5
2011/4/2 6:00	35.5	34.1	21.6	27.0
2011/4/2 7:00	34.4	34.5	21.5	27.5
2011/4/2 8:00	33.5	34.8	21.5	28.0
2011/4/2 9:00	32.6	35.4	21.5	28.5
2011/4/2 10:00	32.0	35.7	21.5	28.5
2011/4/2 11:00	31.5	36.0	27.4	28.5
2011/4/2 12:00	31.1	36.4	28.6	28.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/2 13:00	30.7	36.8	30.0	26.5
2011/4/2 14:00	30.4	37.1	31.8	25.5
2011/4/2 15:00	30.1	37.5	33.8	24.5
2011/4/2 16:00	29.8	37.9	36.2	24.0
2011/4/2 17:00	29.6	38.2	38.0	23.0
2011/4/2 18:00	31.4	38.5	39.5	22.5
2011/4/2 19:00	34.5	38.5	31.2	22.5
2011/4/2 20:00	37.2	38.3	28.6	23.0
2011/4/2 21:00	41.0	37.0	25.9	23.5
2011/4/2 22:00	43.5	35.9	24.6	24.0
2011/4/2 23:00	46.6	35.2	23.3	24.5
2011/4/3 0:00	49.3	34.8	23.5	24.5
2011/4/3 1:00	52.3	33.9	23.7	25.0
2011/4/3 2:00	54.8	33.3	23.1	25.5
2011/4/3 3:00	57.7	32.7	23.6	26.0
2011/4/3 4:00	60.8	32.0	23.4	26.5
2011/4/3 5:00	63.0	31.6	23.2	26.5
2011/4/3 6:00	65.5	31.0	23.2	27.0
2011/4/3 7:00	68.3	30.6	23.1	27.5
2011/4/3 8:00	70.7	30.2	23.0	28.0
2011/4/3 9:00	73.4	29.6	22.9	28.5
2011/4/3 10:00	75.6	29.3	22.8	29.0
2011/4/3 11:00	62.9	29.1	22.8	29.0
2011/4/3 12:00	56.7	29.3	22.8	29.5
2011/4/3 13:00	51.5	29.7	22.7	29.5
2011/4/3 14:00	47.6	30.1	22.8	30.0
2011/4/3 15:00	44.4	30.4	22.8	30.0
2011/4/3 16:00	41.8	30.9	22.7	30.5
2011/4/3 17:00	39.7	31.2	22.7	31.0
2011/4/3 18:00	37.9	31.6	27.1	31.0
2011/4/3 19:00	36.2	32.0	27.8	31.0
2011/4/3 20:00	34.9	32.3	29.3	30.0
2011/4/3 21:00	34.0	32.8	31.1	29.0
2011/4/3 22:00	32.9	33.2	33.7	27.0
2011/4/3 23:00	32.4	33.6	35.5	26.5
2011/4/4 0:00	31.9	33.9	37.3	25.5
2011/4/4 1:00	31.4	34.2	38.9	25.0
2011/4/4 2:00	31.0	34.6	40.7	24.0
2011/4/4 3:00	30.7	35.0	42.2	23.5
2011/4/4 4:00	30.4	35.4	44.0	23.0
2011/4/4 5:00	30.1	35.7	46.0	22.5
2011/4/4 6:00	29.9	36.1	48.0	21.5
2011/4/4 7:00	29.6	36.5	50.2	21.0
2011/4/4 8:00	29.6	36.8	51.6	21.0
2011/4/4 9:00	29.4	37.2	53.4	20.5
2011/4/4 10:00	32.3	37.4	55.5	20.0
2011/4/4 11:00	35.3	37.2	42.6	20.5
2011/4/4 12:00	38.5	37.1	37.6	21.0
2011/4/4 13:00	41.5	35.6	33.4	21.0
2011/4/4 14:00	44.4	34.6	30.1	21.5
2011/4/4 15:00	47.3	34.2	27.7	22.0
2011/4/4 16:00	50.2	33.6	25.9	22.5
2011/4/4 17:00	52.9	32.9	24.5	23.0
2011/4/4 18:00	55.5	32.4	25.2	23.5
2011/4/4 19:00	58.1	31.9	25.5	23.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/4 20:00	48.7	31.5	24.9	24.0
2011/4/4 21:00	45.0	31.8	24.2	24.5
2011/4/4 22:00	42.3	32.2	23.8	25.0
2011/4/4 23:00	40.1	32.5	23.4	25.0
2011/4/5 0:00	38.2	33.0	23.0	25.5
2011/4/5 1:00	38.5	33.2	22.7	26.0
2011/4/5 2:00	37.3	33.6	22.7	26.5
2011/4/5 3:00	36.0	34.0	22.7	27.0
2011/4/5 4:00	35.0	34.3	22.7	27.0
2011/4/5 5:00	34.3	34.7	22.6	27.5
2011/4/5 6:00	33.3	35.2	22.6	28.0
2011/4/5 7:00	32.8	35.5	22.5	28.5
2011/4/5 8:00	31.1	35.8	22.5	29.0
2011/4/5 9:00	30.8	36.2	22.5	29.0
2011/4/5 10:00	32.6	36.4	26.9	29.5
2011/4/5 11:00	36.0	36.3	27.8	29.0
2011/4/5 12:00	39.4	36.1	29.2	28.5
2011/4/5 13:00	42.4	34.8	30.9	27.5
2011/4/5 14:00	45.4	34.0	32.9	26.5
2011/4/5 15:00	48.0	33.6	34.8	26.0
2011/4/5 16:00	51.0	33.0	37.2	25.0
2011/4/5 17:00	53.8	32.4	38.8	24.5
2011/4/5 18:00	56.4	31.9	40.3	24.0
2011/4/5 19:00	59.0	31.4	42.0	23.5
2011/4/5 20:00	49.9	31.1	44.0	23.0
2011/4/5 21:00	48.9	31.4	34.2	23.0
2011/4/5 22:00	43.3	31.7	31.2	23.0
2011/4/5 23:00	41.2	32.2	28.7	23.5
2011/4/6 0:00	39.1	32.5	26.7	24.0
2011/4/6 1:00	37.6	32.9	26.2	24.0
2011/4/6 2:00	36.1	33.2	25.6	25.0
2011/4/6 3:00	35.1	33.6	25.2	25.5
2011/4/6 4:00	34.1	33.9	24.4	26.0
2011/4/6 5:00	33.3	34.4	23.6	26.0
2011/4/6 6:00	32.6	34.8	22.9	26.5
2011/4/6 7:00	32.1	35.1	22.5	26.5
2011/4/6 8:00	31.6	35.5	22.0	27.0
2011/4/6 9:00	31.2	35.9	21.8	28.0
2011/4/6 10:00	33.0	36.2	21.5	28.5
2011/4/6 11:00	37.0	36.1	21.3	28.5
2011/4/6 12:00	39.0	36.0	21.2	29.0
2011/4/6 13:00	42.3	35.2	21.1	29.5
2011/4/6 14:00	45.1	34.1	21.1	29.5
2011/4/6 15:00	47.8	33.6	21.1	30.0
2011/4/6 16:00	50.4	33.2	21.1	30.0
2011/4/6 17:00	53.3	32.5	21.1	30.5
2011/4/6 18:00	56.0	31.9	26.5	30.5
2011/4/6 19:00	58.5	31.5	27.7	30.0
2011/4/6 20:00	49.8	31.3	29.4	28.0
2011/4/6 21:00	46.2	31.5	31.2	27.5
2011/4/6 22:00	43.4	31.8	33.1	26.5
2011/4/6 23:00	43.1	32.2	36.0	26.0
2011/4/7 0:00	39.4	32.5	37.2	25.0
2011/4/7 1:00	37.7	32.9	38.9	24.0
2011/4/7 2:00	36.4	33.3	40.6	23.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/7 3:00	35.0	33.8	42.7	23.0
2011/4/7 4:00	34.2	34.1	44.3	22.5
2011/4/7 5:00	34.4	34.4	46.3	22.0
2011/4/7 6:00	34.8	34.8	48.1	21.5
2011/4/7 7:00	32.3	35.3	50.0	21.0
2011/4/7 8:00	31.8	35.6	51.7	21.0
2011/4/7 9:00	32.3	35.8	53.6	20.5
2011/4/7 10:00	32.8	36.2	55.4	20.0
2011/4/7 11:00	36.0	36.1	42.0	20.5
2011/4/7 12:00	39.1	36.0	37.1	21.0
2011/4/7 13:00	42.5	35.1	33.3	21.5
2011/4/7 14:00	45.3	34.1	30.4	22.0
2011/4/7 15:00	48.1	33.6	28.2	22.0
2011/4/7 16:00	50.8	33.2	26.6	22.5
2011/4/7 17:00	53.4	32.7	25.4	23.0
2011/4/7 18:00	56.0	32.2	24.3	23.5
2011/4/7 19:00	58.7	31.6	23.5	24.0
2011/4/7 20:00	50.3	31.2	22.8	24.0
2011/4/7 21:00	46.6	31.6	22.2	24.5
2011/4/7 22:00	43.9	31.9	21.8	25.0
2011/4/7 23:00	41.5	32.3	21.5	25.5
2011/4/8 0:00	39.6	32.7	21.2	26.0
2011/4/8 1:00	38.2	33.1	21.0	26.5
2011/4/8 2:00	36.8	33.4	20.8	26.5
2011/4/8 3:00	35.8	33.7	20.6	27.0
2011/4/8 4:00	34.8	34.2	21.2	26.5
2011/4/8 5:00	33.9	34.5	21.8	27.5
2011/4/8 6:00	33.2	34.8	22.1	28.0
2011/4/8 7:00	32.6	35.2	22.1	28.5
2011/4/8 8:00	32.1	35.7	22.1	29.0
2011/4/8 9:00	31.7	36.0	22.2	29.0
2011/4/8 10:00	33.3	36.3	22.2	29.5
2011/4/8 11:00	37.2	36.5	22.2	30.0
2011/4/8 12:00	39.7	36.3	22.5	30.0
2011/4/8 13:00	42.5	36.1	22.6	30.5
2011/4/8 14:00	45.5	34.7	22.7	30.5
2011/4/8 15:00	49.7	33.9	22.7	31.0
2011/4/8 16:00	51.3	33.6	22.7	31.5
2011/4/8 17:00	54.0	33.2	22.8	32.0
2011/4/8 18:00	56.4	32.7	22.8	32.5
2011/4/8 19:00	59.5	32.1	26.7	33.0
2011/4/8 20:00	52.1	31.8	27.6	33.0
2011/4/8 21:00	47.7	32.0	29.5	31.5
2011/4/8 22:00	45.6	32.2	30.8	30.0
2011/4/8 23:00	43.2	32.5	32.7	29.5
2011/4/9 0:00	41.2	33.0	34.8	28.5
2011/4/9 1:00	39.2	33.3	37.1	28.0
2011/4/9 2:00	37.8	33.7	38.7	27.0
2011/4/9 3:00	36.5	34.2	40.4	26.0
2011/4/9 4:00	35.5	34.4	42.1	25.0
2011/4/9 5:00	34.6	34.8	44.0	24.0
2011/4/9 6:00	33.8	35.2	45.9	24.0
2011/4/9 7:00	33.2	35.6	47.7	23.0
2011/4/9 8:00	32.6	35.9	49.7	22.5
2011/4/9 9:00	31.8	36.3	51.4	22.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/9 10:00	31.4	36.7	53.2	22.0
2011/4/9 11:00	35.6	36.6	42.6	22.0
2011/4/9 12:00	38.4	36.4	37.4	22.5
2011/4/9 13:00	41.3	36.0	33.3	22.5
2011/4/9 14:00	43.8	34.7	30.5	23.0
2011/4/9 15:00	47.0	34.1	27.8	23.5
2011/4/9 16:00	49.6	33.7	26.1	24.0
2011/4/9 17:00	51.9	33.0	24.9	24.0
2011/4/9 18:00	54.3	32.6	23.9	24.5
2011/4/9 19:00	56.9	32.1	23.0	24.5
2011/4/9 20:00	50.9	31.8	23.1	25.0
2011/4/9 21:00	46.2	32.1	22.9	26.0
2011/4/9 22:00	44.8	32.2	22.9	26.0
2011/4/9 23:00	42.4	32.7	22.8	26.5
2011/4/10 0:00	40.4	32.9	22.6	27.0
2011/4/10 1:00	38.8	33.3	22.6	27.5
2011/4/10 2:00	37.4	33.7	22.6	28.0
2011/4/10 3:00	36.2	34.0	22.4	28.0
2011/4/10 4:00	35.2	34.4	22.4	28.5
2011/4/10 5:00	34.4	34.4	22.3	28.5
2011/4/10 6:00	33.6	35.2	22.3	29.0
2011/4/10 7:00	33.1	35.5	22.2	29.5
2011/4/10 8:00	32.4	36.0	22.2	30.0
2011/4/10 9:00	32.0	36.3	22.2	30.0
2011/4/10 10:00	33.6	36.5	22.2	30.5
2011/4/10 11:00	36.4	36.4	22.2	31.0
2011/4/10 12:00	39.3	36.3	22.2	31.5
2011/4/10 13:00	42.3	35.4	22.2	32.0
2011/4/10 14:00	44.9	34.4	22.2	32.0
2011/4/10 15:00	48.2	33.9	22.3	32.5
2011/4/10 16:00	50.5	33.4	22.5	33.0
2011/4/10 17:00	53.0	32.8	22.6	33.5
2011/4/10 18:00	55.0	32.5	22.6	34.0
2011/4/10 19:00	50.5	32.0	27.3	33.5
2011/4/10 20:00	47.8	32.2	28.3	33.5
2011/4/10 21:00	44.8	32.4	30.0	30.5
2011/4/10 22:00	42.4	32.8	31.9	29.5
2011/4/10 23:00	40.3	33.2	33.7	29.0
2011/4/11 0:00	38.7	33.5	35.9	28.0
2011/4/11 1:00	37.4	33.8	37.5	27.0
2011/4/11 2:00	36.3	34.2	38.9	26.5
2011/4/11 3:00	35.3	34.6	40.6	25.5
2011/4/11 4:00	34.5	35.0	42.3	25.0
2011/4/11 5:00	33.8	35.3	44.1	24.0
2011/4/11 6:00	33.1	35.8	45.9	24.0
2011/4/11 7:00	32.8	36.1	47.4	23.0
2011/4/11 8:00	32.3	36.4	49.4	23.0
2011/4/11 9:00	31.8	36.8	51.2	22.5
2011/4/11 10:00	33.5	37.1	52.0	22.0
2011/4/11 11:00	36.6	37.1	41.5	22.5
2011/4/11 12:00	39.5	36.9	37.2	23.0
2011/4/11 13:00	42.6	36.3	33.4	23.0
2011/4/11 14:00	45.6	34.9	30.5	23.5
2011/4/11 15:00	48.3	34.4	28.4	24.0
2011/4/11 16:00	50.7	33.9	27.0	24.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/11 17:00	53.3	33.4	25.7	24.5
2011/4/11 18:00	55.9	32.8	25.8	25.0
2011/4/11 19:00	58.9	32.3	25.7	25.5
2011/4/11 20:00	49.2	32.0	24.9	24.9
2011/4/11 21:00	47.4	32.2	24.7	26.0
2011/4/11 22:00	44.6	32.4	24.3	26.5
2011/4/11 23:00	41.5	33.0	23.8	27.0
2011/4/12 0:00	40.4	33.2	23.7	27.5
2011/4/12 1:00	38.8	33.6	23.5	28.0
2011/4/12 2:00	37.4	33.9	23.3	28.0
2011/4/12 3:00	36.3	34.2	23.2	28.5
2011/4/12 4:00	35.2	34.7	23.0	29.0
2011/4/12 5:00	34.4	35.0	22.9	29.5
2011/4/12 6:00	33.6	35.4	22.9	29.5
2011/4/12 7:00	33.1	35.7	22.7	30.0
2011/4/12 8:00	32.8	36.0	22.6	30.0
2011/4/12 9:00	32.1	36.4	22.6	30.5
2011/4/12 10:00	34.1	36.6	22.6	31.0
2011/4/12 11:00	37.3	36.5	22.6	31.5
2011/4/12 12:00	41.0	36.2	22.5	32.0
2011/4/12 13:00	43.5	35.8	22.5	32.0
2011/4/12 14:00	46.2	34.3	22.5	32.5
2011/4/12 15:00	48.7	34.0	22.5	33.0
2011/4/12 16:00	51.5	33.4	22.5	33.0
2011/4/12 17:00	54.0	32.8	22.6	33.5
2011/4/12 18:00	56.5	32.4	26.8	33.5
2011/4/12 19:00	59.1	32.0	27.8	33.5
2011/4/12 20:00	48.0	32.0	30.0	31.0
2011/4/12 21:00	46.6	32.0	31.1	30.0
2011/4/12 22:00	43.7	32.5	33.2	29.5
2011/4/12 23:00	41.5	32.7	35.5	29.0
2011/4/13 0:00	39.7	33.1	37.0	28.0
2011/4/13 1:00	37.9	33.6	38.9	27.0
2011/4/13 2:00	37.1	33.8	39.8	26.0
2011/4/13 3:00	36.0	34.2	41.4	25.0
2011/4/13 4:00	35.1	34.5	43.1	24.5
2011/4/13 5:00	34.2	34.9	45.1	24.0
2011/4/13 6:00	33.6	35.2	46.7	23.5
2011/4/13 7:00	32.9	35.6	48.6	23.0
2011/4/13 8:00	32.5	36.0	50.3	23.0
2011/4/13 9:00	32.0	36.3	51.9	22.5
2011/4/13 10:00	34.1	36.6	53.8	22.0
2011/4/13 11:00	37.2	36.5	42.6	22.0
2011/4/13 12:00	40.2	36.2	38.0	22.5
2011/4/13 13:00	43.4	35.1	34.2	23.0
2011/4/13 14:00	46.1	34.4	31.6	23.5
2011/4/13 15:00	49.0	33.9	29.3	24.0
2011/4/13 16:00	51.4	33.3	27.9	24.0
2011/4/13 17:00	54.4	32.8	26.5	24.5
2011/4/13 18:00	57.1	32.4	26.3	25.0
2011/4/13 19:00	59.2	32.0	26.0	25.5
2011/4/13 20:00	48.9	32.0	25.6	26.0
2011/4/13 21:00	46.1	32.2	25.4	26.0
2011/4/13 22:00	43.2	32.5	25.1	26.5
2011/4/13 23:00	41.4	32.8	24.9	27.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/14 0:00	39.6	33.1	24.7	27.5
2011/4/14 1:00	38.2	33.6	24.6	28.0
2011/4/14 2:00	36.8	33.9	24.4	28.5
2011/4/14 3:00	35.9	34.2	24.3	29.0
2011/4/14 4:00	35.0	34.6	24.2	29.0
2011/4/14 5:00	34.2	35.0	24.1	29.5
2011/4/14 6:00	33.5	35.3	24.1	29.5
2011/4/14 7:00	33.0	35.7	24.0	30.0
2011/4/14 8:00	32.6	36.1	24.0	30.0
2011/4/14 9:00	32.1	36.5	23.9	30.5
2011/4/14 10:00	35.4	36.7	23.9	31.0
2011/4/14 11:00	37.5	36.6	23.9	31.5
2011/4/14 12:00	40.3	36.4	23.9	32.0
2011/4/14 13:00	43.2	35.5	23.9	32.0
2011/4/14 14:00	46.0	34.7	23.9	32.5
2011/4/14 15:00	48.9	34.1	24.0	33.0
2011/4/14 16:00	51.3	33.6	24.1	33.0
2011/4/14 17:00	53.8	33.2	24.0	33.5
2011/4/14 18:00	56.3	32.7	23.8	34.0
2011/4/14 19:00	58.6	32.3	27.9	34.0
2011/4/14 20:00	48.9	32.3	29.2	34.0
2011/4/14 21:00	45.6	32.6	31.1	31.0
2011/4/14 22:00	43.1	32.9	33.1	30.0
2011/4/14 23:00	41.3	33.4	35.3	29.5
2011/4/15 0:00	39.9	33.7	36.7	29.0
2011/4/15 1:00	38.6	34.0	38.2	28.5
2011/4/15 2:00	37.2	34.4	39.9	27.7
2011/4/15 3:00	36.3	34.7	41.3	27.0
2011/4/15 4:00	35.3	35.1	43.2	26.0
2011/4/15 5:00	34.6	35.4	45.1	25.0
2011/4/15 6:00	33.9	35.8	47.1	24.5
2011/4/15 7:00	33.4	36.1	48.7	24.0
2011/4/15 8:00	32.9	36.6	50.5	23.5
2011/4/15 9:00	32.4	37.0	52.4	23.0
2011/4/15 10:00	33.5	37.2	45.6	23.0
2011/4/15 11:00	36.7	37.1	39.8	23.0
2011/4/15 12:00	39.0	37.1	36.7	24.0
2011/4/15 13:00	42.3	36.6	33.0	24.5
2011/4/15 14:00	45.1	35.2	30.4	25.0
2011/4/15 15:00	48.1	34.8	28.2	25.5
2011/4/15 16:00	51.2	34.1	26.8	26.0
2011/4/15 17:00	52.9	33.7	26.1	26.0
2011/4/15 18:00	55.8	33.2	25.9	26.5
2011/4/15 19:00	58.3	32.7	25.7	26.5
2011/4/15 20:00	49.6	32.5	25.4	27.0
2011/4/15 21:00	46.5	32.8	25.2	27.5
2011/4/15 22:00	44.1	33.1	25.0	28.0
2011/4/15 23:00	42.2	33.4	24.9	28.5
2011/4/16 0:00	40.5	33.8	24.6	29.0
2011/4/16 1:00	38.8	34.2	24.4	29.0
2011/4/16 2:00	37.7	34.5	24.2	29.5
2011/4/16 3:00	36.6	34.9	24.1	30.0
2011/4/16 4:00	35.6	35.2	24.0	30.0
2011/4/16 5:00	34.9	35.6	23.9	30.0
2011/4/16 6:00	34.2	36.0	23.8	30.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/16 7:00	33.6	36.3	23.8	31.0
2011/4/16 8:00	33.1	36.8	23.8	31.5
2011/4/16 9:00	32.7	37.3	23.7	32.0
2011/4/16 10:00	32.3	37.3	23.7	32.0
2011/4/16 11:00	35.6	37.5	23.7	32.0
2011/4/16 12:00	38.5	37.4	23.7	32.5
2011/4/16 13:00	41.8	37.0	23.8	33.0
2011/4/16 14:00	45.3	35.7	23.8	33.5
2011/4/16 15:00	47.6	35.1	23.9	34.0
2011/4/16 16:00	49.9	34.7	24.0	34.0
2011/4/16 17:00	52.6	34.2	23.9	34.5
2011/4/16 18:00	55.3	33.7	23.8	35.0
2011/4/16 19:00	57.7	33.2	27.8	35.5
2011/4/16 20:00	48.2	33.1	29.3	35.0
2011/4/16 21:00	45.9	33.3	30.7	32.0
2011/4/16 22:00	43.5	33.7	32.9	31.5
2011/4/16 23:00	41.7	34.1	34.8	31.0
2011/4/17 0:00	40.1	34.3	36.8	30.0
2011/4/17 1:00	38.7	34.8	38.3	29.0
2011/4/17 2:00	37.7	35.1	39.8	28.0
2011/4/17 3:00	36.6	35.3	41.4	27.5
2011/4/17 4:00	35.5	35.9	43.5	27.0
2011/4/17 5:00	34.7	36.2	45.2	26.0
2011/4/17 6:00	34.0	36.6	47.0	25.0
2011/4/17 7:00	33.5	36.9	48.8	24.5
2011/4/17 8:00	33.0	37.2	50.4	24.5
2011/4/17 9:00	32.6	37.7	52.1	24.0
2011/4/17 10:00	33.3	37.9	53.8	24.0
2011/4/17 11:00	36.0	37.9	44.6	24.0
2011/4/17 12:00	38.9	37.8	39.6	24.0
2011/4/17 13:00	42.2	36.9	35.5	24.5
2011/4/17 14:00	44.4	35.9	33.3	24.5
2011/4/17 15:00	47.2	35.4	30.8	25.0
2011/4/17 16:00	49.5	34.9	29.3	26.0
2011/4/17 17:00	51.9	34.4	28.1	26.0
2011/4/17 18:00	55.1	33.7	26.8	26.5
2011/4/17 19:00	57.0	33.4	26.1	27.0
2011/4/17 20:00	47.5	33.3	25.4	27.5
2011/4/17 21:00	45.5	33.5	24.9	28.0
2011/4/17 22:00	43.4	33.9	24.5	28.0
2011/4/17 23:00	41.4	34.3	24.1	28.5
2011/4/18 0:00	39.8	34.6	23.7	29.0
2011/4/18 1:00	38.5	35.0	23.4	29.0
2011/4/18 2:00	37.5	35.3	23.1	29.5
2011/4/18 3:00	36.4	35.6	22.9	29.5
2011/4/18 4:00	35.5	36.1	22.6	30.0
2011/4/18 5:00	34.8	36.3	22.5	30.5
2011/4/18 6:00	34.2	36.7	22.4	30.5
2011/4/18 7:00	33.5	37.2	22.3	31.0
2011/4/18 8:00	33.2	37.4	22.2	31.5
2011/4/18 9:00	32.8	37.9	22.1	32.0
2011/4/18 10:00	33.6	38.1	22.1	32.5
2011/4/18 11:00	36.8	38.0	22.1	33.0
2011/4/18 12:00	39.9	37.9	22.1	33.0
2011/4/18 13:00	42.4	37.2	22.1	33.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/18 14:00	45.5	35.9	22.0	34.0
2011/4/18 15:00	48.0	35.5	22.0	34.0
2011/4/18 16:00	50.9	34.8	22.0	34.5
2011/4/18 17:00	53.0	34.4	22.0	35.0
2011/4/18 18:00	55.4	33.9	21.9	35.5
2011/4/18 19:00	57.9	33.4	26.9	35.5
2011/4/18 20:00	50.2	33.1	28.4	33.5
2011/4/18 21:00	47.7	33.3	29.8	32.5
2011/4/18 22:00	45.0	33.5	31.7	31.0
2011/4/18 23:00	44.5	34.0	33.8	30.5
2011/4/19 0:00	42.7	34.3	35.8	29.5
2011/4/19 1:00	39.6	34.6	37.5	29.0
2011/4/19 2:00	38.5	34.9	38.7	28.0
2011/4/19 3:00	37.1	35.3	40.6	27.5
2011/4/19 4:00	36.2	35.7	42.3	26.5
2011/4/19 5:00	35.3	36.2	44.0	26.0
2011/4/19 6:00	34.6	36.4	46.0	25.5
2011/4/19 7:00	34.0	36.8	47.7	25.0
2011/4/19 8:00	33.6	37.2	49.4	24.5
2011/4/19 9:00	33.2	37.5	50.9	24.5
2011/4/19 10:00	33.7	37.8	52.8	24.0
2011/4/19 11:00	35.2	37.9	44.0	24.0
2011/4/19 12:00	38.3	37.6	39.1	24.5
2011/4/19 13:00	41.2	37.2	35.4	25.0
2011/4/19 14:00	43.7	36.0	32.6	25.0
2011/4/19 15:00	46.3	35.4	30.3	25.5
2011/4/19 16:00	48.4	34.9	28.9	26.0
2011/4/19 17:00	51.0	34.3	27.4	26.5
2011/4/19 18:00	53.1	33.8	26.4	26.5
2011/4/19 19:00	55.6	33.2	25.5	27.0
2011/4/19 20:00	48.3	33.2	24.7	27.0
2011/4/19 21:00	44.9	33.4	24.0	28.0
2011/4/19 22:00	43.2	33.6	23.7	28.0
2011/4/19 23:00	41.6	34.0	23.4	28.5
2011/4/20 0:00	40.0	34.5	23.1	29.0
2011/4/20 1:00	38.6	34.7	22.8	29.5
2011/4/20 2:00	37.4	35.1	22.7	29.5
2011/4/20 3:00	36.5	35.5	22.5	30.0
2011/4/20 4:00	35.6	35.8	22.4	30.0
2011/4/20 5:00	34.9	36.1	22.4	30.5
2011/4/20 6:00	34.2	36.6	22.5	31.0
2011/4/20 7:00	33.7	36.9	22.5	31.0
2011/4/20 8:00	33.4	37.2	22.6	32.0
2011/4/20 9:00	33.0	37.7	22.6	32.0
2011/4/20 10:00	34.2	37.9	26.6	32.5
2011/4/20 11:00	37.1	37.6	27.3	33.0
2011/4/20 12:00	39.9	37.5	28.8	33.0
2011/4/20 13:00	42.4	36.7	30.3	33.5
2011/4/20 14:00	45.2	35.7	32.1	34.0
2011/4/20 15:00	47.7	35.3	33.9	34.5
2011/4/20 16:00	50.1	34.9	35.9	35.0
2011/4/20 17:00	52.4	34.3	29.6	35.0
2011/4/20 18:00	54.8	33.8	28.2	35.5
2011/4/20 19:00	57.3	33.5	30.8	35.5
2011/4/20 20:00	50.5	33.1	31.5	35.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/20 21:00	46.5	33.5	33.0	33.0
2011/4/20 22:00	45.5	33.7	35.3	32.0
2011/4/20 23:00	43.4	34.0	36.9	31.5
2011/4/21 0:00	41.6	34.3	38.6	30.5
2011/4/21 1:00	40.3	34.7	39.9	30.0
2011/4/21 2:00	39.0	35.1	41.6	29.5
2011/4/21 3:00	37.9	35.4	43.3	29.0
2011/4/21 4:00	37.1	35.6	44.7	28.0
2011/4/21 5:00	36.1	36.2	46.7	27.5
2011/4/21 6:00	35.3	36.4	48.8	27.0
2011/4/21 7:00	34.7	36.9	50.3	26.5
2011/4/21 8:00	34.0	37.2	51.5	26.0
2011/4/21 9:00	33.9	37.5	53.5	25.5
2011/4/21 10:00	34.4	37.9	47.1	25.5
2011/4/21 11:00	37.8	37.8	40.8	25.5
2011/4/21 12:00	38.6	37.7	38.1	26.0
2011/4/21 13:00	42.7	37.2	35.2	26.5
2011/4/21 14:00	45.5	36.2	32.7	27.0
2011/4/21 15:00	47.8	35.8	31.0	27.0
2011/4/21 16:00	50.5	35.3	29.5	27.0
2011/4/21 17:00	52.7	34.8	28.3	28.0
2011/4/21 18:00	55.2	34.4	27.3	28.0
2011/4/21 19:00	57.4	34.0	26.5	29.0
2011/4/21 20:00	50.9	33.8	25.7	29.0
2011/4/21 21:00	47.9	34.0	25.3	29.0
2011/4/21 22:00	45.5	34.4	24.9	29.5
2011/4/21 23:00	43.5	34.7	24.6	30.0
2011/4/22 0:00	42.0	35.0	24.3	30.0
2011/4/22 1:00	40.6	35.4	24.1	30.5
2011/4/22 2:00	39.3	35.7	23.9	31.0
2011/4/22 3:00	38.3	36.1	23.8	31.5
2011/4/22 4:00	37.4	36.4	23.7	31.5
2011/4/22 5:00	36.6	36.8	23.6	32.0
2011/4/22 6:00	35.9	37.1	23.6	32.0
2011/4/22 7:00	35.4	37.5	23.5	32.5
2011/4/22 8:00	34.9	37.9	23.5	33.0
2011/4/22 9:00	34.4	38.2	23.4	33.5
2011/4/22 10:00	35.0	38.5	23.4	33.5
2011/4/22 11:00	38.1	38.4	23.4	34.0
2011/4/22 12:00	40.9	38.2	23.3	34.5
2011/4/22 13:00	43.6	37.7	23.3	35.0
2011/4/22 14:00	46.3	36.6	23.3	35.5
2011/4/22 15:00	48.9	36.2	23.3	36.0
2011/4/22 16:00	51.6	35.7	23.3	36.0
2011/4/22 17:00	53.8	35.2	23.3	36.5
2011/4/22 18:00	56.5	34.7	27.2	36.5
2011/4/22 19:00	58.7	34.3	28.5	36.5
2011/4/22 20:00	50.0	34.2	30.3	34.0
2011/4/22 21:00	47.5	34.5	31.9	33.0
2011/4/22 22:00	45.2	34.9	34.2	32.0
2011/4/22 23:00	43.4	35.1	35.8	31.0
2011/4/23 0:00	41.9	35.5	37.3	30.5
2011/4/23 1:00	40.3	35.8	38.9	29.5
2011/4/23 2:00	39.1	36.3	40.4	29.0
2011/4/23 3:00	38.2	36.5	42.0	28.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/23 4:00	37.3	36.9	43.9	28.0
2011/4/23 5:00	36.5	37.3	45.5	27.5
2011/4/23 6:00	35.8	37.6	47.5	27.0
2011/4/23 7:00	35.3	37.9	49.1	26.5
2011/4/23 8:00	34.8	38.3	50.9	26.0
2011/4/23 9:00	34.4	38.7	52.3	25.5
2011/4/23 10:00	34.9	39.0	53.8	25.0
2011/4/23 11:00	38.3	38.9	46.8	25.0
2011/4/23 12:00	40.4	38.8	43.0	25.5
2011/4/23 13:00	43.5	38.2	39.2	26.0
2011/4/23 14:00	46.4	36.9	36.1	26.5
2011/4/23 15:00	48.8	36.6	34.1	27.0
2011/4/23 16:00	51.5	36.1	32.1	27.0
2011/4/23 17:00	53.8	35.6	30.8	27.5
2011/4/23 18:00	56.3	35.1	29.5	28.0
2011/4/23 19:00	58.6	34.8	28.6	28.5
2011/4/23 20:00	48.7	34.8	27.8	29.0
2011/4/23 21:00	46.3	35.1	27.1	29.0
2011/4/23 22:00	44.4	35.4	26.6	29.5
2011/4/23 23:00	42.7	35.8	26.1	29.5
2011/4/24 0:00	41.4	36.1	25.8	30.0
2011/4/24 1:00	40.2	36.4	25.5	30.0
2011/4/24 2:00	39.0	36.8	25.2	30.5
2011/4/24 3:00	38.2	37.1	25.0	31.0
2011/4/24 4:00	37.4	37.5	24.8	31.0
2011/4/24 5:00	36.7	37.8	24.4	31.5
2011/4/24 6:00	36.1	38.1	24.6	32.0
2011/4/24 7:00	35.6	38.6	24.4	32.5
2011/4/24 8:00	35.1	38.9	24.4	33.0
2011/4/24 9:00	34.7	39.2	24.3	33.5
2011/4/24 10:00	35.6	39.6	24.2	33.5
2011/4/24 11:00	39.7	39.3	24.2	34.0
2011/4/24 12:00	40.8	39.2	24.1	34.5
2011/4/24 13:00	43.4	38.4	24.1	34.5
2011/4/24 14:00	46.3	37.5	24.1	35.0
2011/4/24 15:00	48.5	37.1	24.1	35.5
2011/4/24 16:00	50.6	36.7	24.1	36.0
2011/4/24 17:00	53.7	35.9	24.1	36.5
2011/4/24 18:00	56.1	35.5	24.2	37.0
2011/4/24 19:00	58.1	35.2	28.1	36.5
2011/4/24 20:00	60.8	34.7	30.1	35.0
2011/4/24 21:00	62.6	34.4	31.6	34.5
2011/4/24 22:00	58.4	34.1	33.3	34.0
2011/4/24 23:00	55.0	34.1	35.3	32.5
2011/4/25 0:00	51.8	34.4	36.9	32.0
2011/4/25 1:00	49.0	34.8	38.4	31.0
2011/4/25 2:00	46.8	35.1	39.9	30.0
2011/4/25 3:00	44.9	35.5	41.5	29.5
2011/4/25 4:00	43.3	35.8	43.3	29.5
2011/4/25 5:00	41.8	36.2	45.0	28.5
2011/4/25 6:00	40.5	36.6	46.9	28.5
2011/4/25 7:00	39.4	37.0	48.8	28.0
2011/4/25 8:00	38.7	37.3	50.2	27.5
2011/4/25 9:00	37.5	37.9	52.6	27.0
2011/4/25 10:00	37.2	38.0	53.5	26.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/25 11:00	36.6	38.3	44.5	26.5
2011/4/25 12:00	36.1	38.6	41.2	27.0
2011/4/25 13:00	37.2	39.0	38.1	27.5
2011/4/25 14:00	39.7	39.3	36.1	28.0
2011/4/25 15:00	43.0	39.6	34.0	28.5
2011/4/25 16:00	45.9	40.0	32.3	28.5
2011/4/25 17:00	48.1	40.3	31.2	29.0
2011/4/25 18:00	50.5	40.1	30.1	29.5
2011/4/25 19:00	52.9	39.9	29.3	29.5
2011/4/25 20:00	55.6	39.0	28.5	30.0
2011/4/25 21:00	58.0	38.5	27.9	30.0
2011/4/25 22:00	60.6	38.0	27.3	30.5
2011/4/25 23:00	62.2	37.8	27.0	31.0
2011/4/26 0:00	53.3	37.5	26.6	31.5
2011/4/26 1:00	50.5	37.8	26.3	32.0
2011/4/26 2:00	48.0	38.1	26.1	32.5
2011/4/26 3:00	46.0	38.4	25.9	32.5
2011/4/26 4:00	44.2	38.8	25.7	33.0
2011/4/26 5:00	42.7	39.1	25.5	33.0
2011/4/26 6:00	41.1	39.5	25.4	33.5
2011/4/26 7:00	39.9	40.0	25.2	34.0
2011/4/26 8:00	39.1	40.3	25.1	34.5
2011/4/26 9:00	39.0	40.6	25.0	35.0
2011/4/26 10:00	40.6	40.6	25.0	35.5
2011/4/26 11:00	43.1	40.4	24.9	36.0
2011/4/26 12:00	45.9	40.0	24.9	36.0
2011/4/26 13:00	48.6	39.1	24.8	36.5
2011/4/26 14:00	51.1	38.7	24.8	37.0
2011/4/26 15:00	53.7	38.3	24.8	37.0
2011/4/26 16:00	55.8	37.9	24.8	37.5
2011/4/26 17:00	58.3	37.5	24.8	37.5
2011/4/26 18:00	60.6	37.1	27.6	38.0
2011/4/26 19:00	63.0	36.8	28.7	38.0
2011/4/26 20:00	54.9	36.8	30.2	37.0
2011/4/26 21:00	51.6	37.1	32.2	35.0
2011/4/26 22:00	49.0	37.3	34.3	34.5
2011/4/26 23:00	46.7	37.7	36.3	34.0
2011/4/27 0:00	44.8	38.0	37.9	33.0
2011/4/27 1:00	43.2	38.3	39.3	32.0
2011/4/27 2:00	42.0	38.7	40.8	31.0
2011/4/27 3:00	41.0	39.0	42.3	31.0
2011/4/27 4:00	39.9	39.4	44.2	30.0
2011/4/27 5:00	39.0	39.7	45.9	29.5
2011/4/27 6:00	38.3	40.1	47.9	28.5
2011/4/27 7:00	37.6	40.4	49.5	28.5
2011/4/27 8:00	37.0	40.8	51.1	28.0
2011/4/27 9:00	35.4	41.1	52.8	27.5
2011/4/27 10:00	37.5	41.3	54.3	27.0
2011/4/27 11:00	40.4	41.1	44.3	27.0
2011/4/27 12:00	42.8	40.8	40.9	27.5
2011/4/27 13:00	45.8	39.5	37.6	28.5
2011/4/27 14:00	48.1	39.1	35.5	29.0
2011/4/27 15:00	50.4	38.8	33.6	29.0
2011/4/27 16:00	52.7	38.3	32.1	29.5
2011/4/27 17:00	55.0	37.8	30.9	30.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/27 18:00	58.2	37.5	29.8	30.0
2011/4/27 19:00	59.4	37.1	29.2	30.0
2011/4/27 20:00	53.4	37.0	28.6	30.5
2011/4/27 21:00	50.5	37.4	32.6	30.5
2011/4/27 22:00	48.2	37.6	34.1	30.0
2011/4/27 23:00	47.5	37.9	35.9	29.5
2011/4/28 0:00	45.7	38.3	37.5	29.0
2011/4/28 1:00	43.3	38.6	39.0	29.0
2011/4/28 2:00	41.9	39.0	40.7	28.5
2011/4/28 3:00	41.0	39.2	42.1	28.0
2011/4/28 4:00	40.1	39.6	43.9	27.0
2011/4/28 5:00	39.4	39.9	45.6	27.0
2011/4/28 6:00	38.7	40.4	47.5	27.0
2011/4/28 7:00	38.1	40.7	49.3	26.5
2011/4/28 8:00	37.6	41.0	50.9	26.5
2011/4/28 9:00	37.1	41.3	52.5	26.0
2011/4/28 10:00	38.7	41.6	46.2	26.0
2011/4/28 11:00	41.3	41.4	43.2	26.5
2011/4/28 12:00	43.9	41.1	40.3	27.0
2011/4/28 13:00	46.4	40.1	37.7	27.5
2011/4/28 14:00	48.9	39.5	35.6	28.0
2011/4/28 15:00	51.4	39.1	33.7	28.0
2011/4/28 16:00	53.8	38.7	32.2	28.5
2011/4/28 17:00	55.8	38.3	31.2	29.0
2011/4/28 18:00	58.0	37.9	30.2	29.5
2011/4/28 19:00	60.5	37.5	29.3	30.0
2011/4/28 20:00	57.7	37.1	28.7	30.0
2011/4/28 21:00	54.2	37.2	28.2	30.0
2011/4/28 22:00	51.3	37.5	27.7	30.5
2011/4/28 23:00	48.7	37.9	27.2	30.5
2011/4/29 0:00	46.6	38.2	26.8	31.0
2011/4/29 1:00	45.1	38.5	26.6	31.0
2011/4/29 2:00	43.3	38.9	26.2	32.0
2011/4/29 3:00	42.0	39.2	26.0	32.5
2011/4/29 4:00	41.0	39.5	25.7	33.0
2011/4/29 5:00	40.0	39.9	25.5	33.0
2011/4/29 6:00	39.1	40.3	25.3	33.5
2011/4/29 7:00	38.4	40.6	25.2	34.0
2011/4/29 8:00	37.9	41.1	25.1	34.0
2011/4/29 9:00	37.3	41.4	25.0	34.5
2011/4/29 10:00	38.2	41.6	24.9	35.0
2011/4/29 11:00	41.2	41.4	24.9	35.5
2011/4/29 12:00	43.7	41.2	24.8	36.0
2011/4/29 13:00	47.0	40.1	24.8	36.5
2011/4/29 14:00	48.9	39.6	24.8	36.5
2011/4/29 15:00	51.3	39.2	24.9	37.0
2011/4/29 16:00	53.7	38.9	24.9	37.0
2011/4/29 17:00	55.9	38.4	24.9	37.5
2011/4/29 18:00	58.4	38.0	24.9	38.0
2011/4/29 19:00	60.8	37.7	28.6	37.5
2011/4/29 20:00	62.7	37.3	30.1	37.5
2011/4/29 21:00	64.9	37.0	31.9	35.0
2011/4/29 22:00	57.1	36.9	33.8	35.0
2011/4/29 23:00	53.7	37.1	36.0	34.0
2011/4/30 0:00	50.7	37.4	37.6	33.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/4/30 1:00	48.4	37.8	39.2	32.0
2011/4/30 2:00	46.3	38.1	40.8	31.0
2011/4/30 3:00	44.8	38.4	42.1	30.5
2011/4/30 4:00	42.7	38.9	44.6	30.0
2011/4/30 5:00	42.0	39.1	45.6	29.5
2011/4/30 6:00	40.7	39.6	47.7	29.0
2011/4/30 7:00	40.0	39.9	49.2	28.5
2011/4/30 8:00	39.3	40.3	50.7	28.0
2011/4/30 9:00	38.5	40.6	52.6	28.0
2011/4/30 10:00	40.9	40.6	54.2	27.5
2011/4/30 11:00	42.5	40.5	46.0	28.0
2011/4/30 12:00	46.1	40.1	42.5	28.0
2011/4/30 13:00	48.5	39.3	39.5	28.0
2011/4/30 14:00	51.4	38.6	36.7	29.0
2011/4/30 15:00	53.0	38.4	35.3	29.0
2011/4/30 16:00	55.5	38.0	33.4	29.5
2011/4/30 17:00	57.7	37.6	32.1	29.5
2011/4/30 18:00	59.7	37.3	31.0	30.0
2011/4/30 19:00	61.9	37.0	30.1	30.1
2011/4/30 20:00	64.0	36.8	30.0	29.3
2011/4/30 21:00	56.3	36.8	28.5	31.0
2011/4/30 22:00	53.4	37.0	28.1	31.0
2011/4/30 23:00	50.5	37.3	27.5	32.0
2011/5/1 0:00	48.2	37.6	27.1	32.0
2011/5/1 1:00	46.1	37.9	26.8	32.5
2011/5/1 2:00	44.5	38.3	26.4	33.0
2011/5/1 3:00	42.8	38.7	26.0	33.5
2011/5/1 4:00	41.8	38.9	25.8	33.5
2011/5/1 5:00	40.7	39.3	25.5	34.0
2011/5/1 6:00	39.7	39.7	25.3	34.5
2011/5/1 7:00	39.1	40.0	25.2	35.0
2011/5/1 8:00	38.4	40.5	25.0	35.0
2011/5/1 9:00	37.7	40.9	24.9	35.5
2011/5/1 10:00	40.0	40.8	27.8	36.0
2011/5/1 11:00	42.9	40.5	28.9	36.0
2011/5/1 12:00	45.4	40.2	30.2	35.0
2011/5/1 13:00	48.2	39.4	32.1	33.5
2011/5/1 14:00	50.3	39.0	33.6	33.5
2011/5/1 15:00	53.1	38.6	36.1	32.0
2011/5/1 16:00	55.1	38.2	37.4	31.0
2011/5/1 17:00	57.6	37.8	39.0	30.0
2011/5/1 18:00	59.5	37.4	40.3	29.5
2011/5/1 19:00	62.5	37.0	42.2	29.0
2011/5/1 20:00	64.3	36.7	38.9	29.0
2011/5/1 21:00	56.0	36.9	36.8	29.0
2011/5/1 22:00	52.4	37.1	34.5	29.5
2011/5/1 23:00	50.0	37.4	32.8	30.0
2011/5/2 0:00	47.7	37.8	31.5	30.0
2011/5/2 1:00	46.3	38.0	30.5	30.5
2011/5/2 2:00	44.4	38.4	29.4	31.0
2011/5/2 3:00	43.1	38.7	28.6	31.0
2011/5/2 4:00	41.2	39.3	27.5	32.0
2011/5/2 5:00	40.8	39.4	27.3	32.0
2011/5/2 6:00	39.8	39.8	26.7	32.5
2011/5/2 7:00	39.2	40.1	26.4	32.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/2 8:00	38.6	40.6	26.0	33.0
2011/5/2 9:00	38.0	40.8	25.7	33.5
2011/5/2 10:00	40.2	40.9	25.4	34.0
2011/5/2 11:00	43.0	40.7	25.2	34.5
2011/5/2 12:00	45.7	40.4	29.1	35.0
2011/5/2 13:00	48.3	39.6	30.3	35.5
2011/5/2 14:00	50.5	39.0	31.8	36.0
2011/5/2 15:00	53.1	39.1	30.4	36.0
2011/5/2 16:00	55.7	39.1	29.1	36.0
2011/5/2 17:00	58.0	39.0	28.3	36.5
2011/5/2 18:00	60.3	38.6	27.5	37.0
2011/5/2 19:00	63.0	37.9	26.8	37.5
2011/5/2 20:00	64.8	37.5	26.4	38.0
2011/5/2 21:00	59.0	37.1	29.7	37.5
2011/5/2 22:00	55.0	37.2	31.0	37.0
2011/5/2 23:00	51.8	37.5	32.7	35.5
2011/5/3 0:00	48.9	37.8	34.9	34.0
2011/5/3 1:00	46.7	38.2	36.3	33.0
2011/5/3 2:00	44.7	38.5	37.8	32.5
2011/5/3 3:00	43.0	38.9	39.2	32.0
2011/5/3 4:00	41.6	39.3	40.7	31.0
2011/5/3 5:00	40.4	39.5	42.2	30.0
2011/5/3 6:00	39.3	39.9	44.0	30.0
2011/5/3 7:00	38.4	40.2	45.7	29.0
2011/5/3 8:00	37.7	40.6	47.5	28.5
2011/5/3 9:00	37.1	41.0	49.0	28.0
2011/5/3 10:00	37.9	41.3	50.7	28.0
2011/5/3 11:00	40.4	41.1	42.1	28.0
2011/5/3 12:00	43.2	40.8	39.0	28.5
2011/5/3 13:00	46.4	39.9	36.2	29.0
2011/5/3 14:00	48.6	39.2	34.5	29.0
2011/5/3 15:00	51.4	39.0	32.6	29.5
2011/5/3 16:00	54.1	38.5	31.1	30.0
2011/5/3 17:00	57.1	38.0	29.8	30.0
2011/5/3 18:00	58.6	37.5	29.2	30.5
2011/5/3 19:00	60.2	37.3	28.7	30.5
2011/5/3 20:00	62.9	36.8	27.9	31.0
2011/5/3 21:00	54.5	36.8	27.4	31.5
2011/5/3 22:00	51.4	37.1	26.9	32.0
2011/5/3 23:00	49.0	37.4	26.6	32.5
2011/5/4 0:00	47.0	37.7	26.3	33.0
2011/5/4 1:00	45.2	38.0	26.0	33.5
2011/5/4 2:00	43.8	38.3	25.8	33.5
2011/5/4 3:00	42.4	38.7	25.6	34.0
2011/5/4 4:00	41.1	39.1	25.4	34.5
2011/5/4 5:00	40.2	39.4	25.2	35.0
2011/5/4 6:00	39.3	39.7	25.1	35.0
2011/5/4 7:00	38.6	40.1	25.1	35.0
2011/5/4 8:00	37.9	40.5	24.9	35.5
2011/5/4 9:00	37.4	40.8	24.8	36.0
2011/5/4 10:00	36.3	41.1	24.8	36.5
2011/5/4 11:00	40.2	41.0	28.4	36.5
2011/5/4 12:00	42.9	40.8	29.9	36.0
2011/5/4 13:00	45.8	40.0	31.9	34.0
2011/5/4 14:00	48.0	39.0	33.5	33.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/4 15:00	50.3	38.6	35.7	32.5
2011/5/4 16:00	52.8	38.3	37.3	31.5
2011/5/4 17:00	55.0	38.1	38.7	30.5
2011/5/4 18:00	57.0	37.6	40.1	30.5
2011/5/4 19:00	59.1	37.3	41.5	30.0
2011/5/4 20:00	61.7	36.8	43.4	29.5
2011/5/4 21:00	56.6	36.5	44.8	29.0
2011/5/4 22:00	53.4	36.8	37.5	29.0
2011/5/4 23:00	50.8	37.0	35.4	29.0
2011/5/5 0:00	48.7	37.4	33.8	29.5
2011/5/5 1:00	46.6	37.8	32.2	30.0
2011/5/5 2:00	45.0	38.1	32.1	30.0
2011/5/5 3:00	43.6	38.4	30.1	31.0
2011/5/5 4:00	42.2	38.7	29.2	31.0
2011/5/5 5:00	41.2	39.0	28.5	31.5
2011/5/5 6:00	40.2	39.4	27.9	32.0
2011/5/5 7:00	39.2	39.8	27.4	32.5
2011/5/5 8:00	38.6	40.1	27.0	33.0
2011/5/5 9:00	38.1	40.5	26.7	33.0
2011/5/5 10:00	39.1	40.7	26.3	33.5
2011/5/5 11:00	40.9	40.5	26.2	34.0
2011/5/5 12:00	43.4	40.3	26.0	34.5
2011/5/5 13:00	45.9	39.7	25.8	34.5
2011/5/5 14:00	48.4	39.1	25.6	35.0
2011/5/5 15:00	50.6	38.8	25.5	35.5
2011/5/5 16:00	53.1	38.5	25.4	36.0
2011/5/5 17:00	55.1	38.0	25.4	36.0
2011/5/5 18:00	57.5	37.7	25.4	36.5
2011/5/5 19:00	59.6	37.3	29.0	36.5
2011/5/5 20:00	61.7	37.0	30.5	35.5
2011/5/5 21:00	63.8	36.8	32.3	34.5
2011/5/5 22:00	65.8	36.5	34.1	33.5
2011/5/5 23:00	57.7	36.2	36.2	32.5
2011/5/6 0:00	58.2	36.4	37.7	32.0
2011/5/6 1:00	55.4	36.7	36.7	31.5
2011/5/6 2:00	52.5	36.9	40.4	31.0
2011/5/6 3:00	50.1	37.4	41.9	30.5
2011/5/6 4:00	47.8	37.7	43.7	30.0
2011/5/6 5:00	46.1	38.0	45.3	29.5
2011/5/6 6:00	44.5	38.4	47.1	29.0
2011/5/6 7:00	42.8	38.9	49.3	28.5
2011/5/6 8:00	42.0	39.1	50.3	28.5
2011/5/6 9:00	41.1	39.4	52.0	28.0
2011/5/6 10:00	42.5	39.6	53.5	28.0
2011/5/6 11:00	45.1	39.5	44.3	28.0
2011/5/6 12:00	47.6	39.3	41.2	28.5
2011/5/6 13:00	50.3	38.7	38.3	29.0
2011/5/6 14:00	52.3	38.4	36.5	29.0
2011/5/6 15:00	54.8	38.1	34.6	29.5
2011/5/6 16:00	56.9	37.7	33.3	29.5
2011/5/6 17:00	59.2	37.5	32.1	30.0
2011/5/6 18:00	61.3	37.1	31.1	30.5
2011/5/6 19:00	63.6	36.7	30.2	30.5
2011/5/6 20:00	65.7	36.5	29.6	31.0
2011/5/6 21:00	67.6	36.4	29.0	31.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/6 22:00	61.0	36.2	28.5	32.0
2011/5/6 23:00	57.6	36.5	28.1	32.0
2011/5/7 0:00	54.0	36.8	27.7	33.0
2011/5/7 1:00	51.9	37.1	27.5	33.0
2011/5/7 2:00	49.6	37.6	27.2	33.5
2011/5/7 3:00	47.8	37.8	27.0	34.0
2011/5/7 4:00	46.1	38.3	26.8	34.5
2011/5/7 5:00	44.8	38.6	26.7	34.5
2011/5/7 6:00	43.6	38.8	26.5	35.0
2011/5/7 7:00	42.6	39.3	26.4	35.0
2011/5/7 8:00	41.8	39.6	26.3	35.5
2011/5/7 9:00	41.1	39.9	26.2	36.0
2011/5/7 10:00	42.1	40.0	26.1	36.5
2011/5/7 11:00	44.9	40.0	26.1	37.0
2011/5/7 12:00	47.6	39.6	26.1	37.0
2011/5/7 13:00	50.0	39.2	26.1	37.5
2011/5/7 14:00	52.6	38.9	26.1	38.0
2011/5/7 15:00	55.0	38.5	26.1	38.0
2011/5/7 16:00	57.3	38.2	26.1	38.5
2011/5/7 17:00	59.4	38.0	26.1	38.5
2011/5/7 18:00	61.7	37.7	26.1	39.0
2011/5/7 19:00	64.0	37.3	29.7	39.0
2011/5/7 20:00	66.0	37.2	31.2	38.5
2011/5/7 21:00	59.4	37.1	32.9	36.5
2011/5/7 22:00	56.1	37.4	34.6	36.0
2011/5/7 23:00	53.3	37.6	36.8	35.0
2011/5/8 0:00	52.1	38.1	38.5	34.5
2011/5/8 1:00	50.1	38.4	39.9	33.5
2011/5/8 2:00	47.4	38.6	41.3	33.0
2011/5/8 3:00	46.0	39.1	42.8	32.5
2011/5/8 4:00	44.6	39.4	44.6	31.0
2011/5/8 5:00	43.5	39.7	46.4	30.5
2011/5/8 6:00	42.5	40.1	47.9	30.0
2011/5/8 7:00	41.6	40.4	50.0	29.5
2011/5/8 8:00	40.9	40.7	51.2	29.0
2011/5/8 9:00	40.4	41.1	52.8	29.0
2011/5/8 10:00	42.3	41.3	54.3	29.5
2011/5/8 11:00	45.0	41.1	43.6	29.0
2011/5/8 12:00	47.4	40.8	40.7	29.0
2011/5/8 13:00	51.5	39.9	36.8	29.5
2011/5/8 14:00	52.9	39.6	35.7	30.0
2011/5/8 15:00	55.0	39.4	34.2	30.0
2011/5/8 16:00	57.1	39.2	32.9	30.5
2011/5/8 17:00	57.0	38.9	31.7	31.0
2011/5/8 18:00	61.7	38.5	30.8	31.0
2011/5/8 19:00	63.9	38.2	30.0	31.5
2011/5/8 20:00	66.0	38.0	29.4	32.0
2011/5/8 21:00	68.1	37.7	28.7	32.5
2011/5/8 22:00	60.4	37.6	28.3	33.0
2011/5/8 23:00	57.1	38.0	27.9	33.5
2011/5/9 0:00	54.5	38.3	27.5	34.0
2011/5/9 1:00	52.4	38.6	27.2	34.0
2011/5/9 2:00	50.3	39.0	27.0	34.5
2011/5/9 3:00	48.8	39.3	26.8	34.5
2011/5/9 4:00	47.2	39.6	26.5	35.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/9 5:00	45.9	39.9	26.3	35.5
2011/5/9 6:00	44.8	40.3	26.2	35.5
2011/5/9 7:00	43.8	40.6	26.0	36.0
2011/5/9 8:00	42.5	41.2	25.9	36.5
2011/5/9 9:00	42.3	41.4	25.9	36.5
2011/5/9 10:00	44.7	41.3	25.7	37.0
2011/5/9 11:00	48.0	41.0	25.6	37.5
2011/5/9 12:00	50.5	40.6	25.6	38.0
2011/5/9 13:00	52.3	40.2	25.5	38.0
2011/5/9 14:00	54.5	40.0	25.5	38.5
2011/5/9 15:00	56.7	39.7	25.5	38.5
2011/5/9 16:00	59.2	39.4	25.6	39.0
2011/5/9 17:00	61.7	39.1	25.6	39.5
2011/5/9 18:00	63.5	38.9	26.0	39.5
2011/5/9 19:00	65.8	38.6	29.6	39.5
2011/5/9 20:00	67.9	38.4	31.3	38.0
2011/5/9 21:00	62.3	38.3	33.0	37.0
2011/5/9 22:00	58.4	38.5	35.1	36.0
2011/5/9 23:00	56.1	38.7	36.8	35.5
2011/5/10 0:00	53.7	39.1	38.3	35.0
2011/5/10 1:00	51.7	39.5	39.7	34.0
2011/5/10 2:00	50.0	39.8	41.2	33.0
2011/5/10 3:00	48.5	40.1	42.8	32.0
2011/5/10 4:00	47.2	40.5	44.5	32.0
2011/5/10 5:00	46.1	40.8	46.1	31.5
2011/5/10 6:00	45.2	41.1	47.8	30.5
2011/5/10 7:00	44.2	41.6	49.6	30.0
2011/5/10 8:00	43.4	41.8	51.2	30.0
2011/5/10 9:00	42.8	42.1	52.7	29.5
2011/5/10 10:00	44.9	42.2	54.1	29.0
2011/5/10 11:00	47.8	42.0	44.0	29.5
2011/5/10 12:00	49.9	41.8	41.6	29.5
2011/5/10 13:00	52.7	41.1	38.6	30.0
2011/5/10 14:00	55.1	40.8	36.7	30.5
2011/5/10 15:00	57.3	40.4	34.9	31.0
2011/5/10 16:00	59.4	40.1	33.5	31.0
2011/5/10 17:00	61.6	39.8	32.3	31.5
2011/5/10 18:00	63.9	39.6	31.3	32.0
2011/5/10 19:00	65.8	39.3	30.5	32.0
2011/5/10 20:00	68.1	38.9	29.7	32.5
2011/5/10 21:00	70.1	38.7	29.1	33.0
2011/5/10 22:00	61.3	38.9	28.6	33.5
2011/5/10 23:00	58.2	39.2	28.1	34.0
2011/5/11 0:00	55.7	39.4	27.7	34.5
2011/5/11 1:00	53.4	39.7	27.4	34.5
2011/5/11 2:00	51.4	40.1	27.1	35.0
2011/5/11 3:00	49.8	40.5	26.9	35.0
2011/5/11 4:00	48.4	40.7	26.7	35.0
2011/5/11 5:00	47.0	41.2	26.5	36.0
2011/5/11 6:00	46.0	41.5	26.3	36.5
2011/5/11 7:00	44.8	41.8	26.2	37.0
2011/5/11 8:00	44.1	42.1	26.1	37.0
2011/5/11 9:00	42.7	42.5	26.0	37.5
2011/5/11 10:00	43.8	42.7	26.0	37.5
2011/5/11 11:00	46.3	42.5	25.9	38.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/11 12:00	49.0	42.3	25.8	38.5
2011/5/11 13:00	51.5	41.8	25.9	39.0
2011/5/11 14:00	53.6	41.3	25.9	39.0
2011/5/11 15:00	55.9	40.9	25.9	39.5
2011/5/11 16:00	58.3	40.7	25.9	40.0
2011/5/11 17:00	60.1	40.4	25.9	40.0
2011/5/11 18:00	62.4	40.0	29.6	40.0
2011/5/11 19:00	64.4	39.7	31.2	39.0
2011/5/11 20:00	66.4	39.5	32.9	37.5
2011/5/11 21:00	62.1	39.2	35.2	36.0
2011/5/11 22:00	58.9	39.4	37.1	35.5
2011/5/11 23:00	56.5	39.7	38.4	34.5
2011/5/12 0:00	54.3	40.1	39.8	34.0
2011/5/12 1:00	52.2	40.4	41.3	33.5
2011/5/12 2:00	50.4	40.7	42.8	33.0
2011/5/12 3:00	49.0	41.0	44.4	32.5
2011/5/12 4:00	47.6	41.4	46.2	31.0
2011/5/12 5:00	46.4	41.7	47.8	30.5
2011/5/12 6:00	45.3	42.0	49.6	30.0
2011/5/12 7:00	44.6	42.4	51.1	29.5
2011/5/12 8:00	43.7	42.8	52.5	29.0
2011/5/12 9:00	43.0	43.0	54.3	29.0
2011/5/12 10:00	44.4	43.2	55.8	28.5
2011/5/12 11:00	47.1	43.0	46.1	29.0
2011/5/12 12:00	49.5	42.9	42.7	29.0
2011/5/12 13:00	52.1	42.2	39.8	29.5
2011/5/12 14:00	54.4	41.7	37.5	29.5
2011/5/12 15:00	56.7	41.3	35.5	30.0
2011/5/12 16:00	58.8	41.1	33.9	30.5
2011/5/12 17:00	61.1	40.8	32.4	30.5
2011/5/12 18:00	63.4	40.4	31.2	31.0
2011/5/12 19:00	65.1	40.1	30.5	31.5
2011/5/12 20:00	67.3	39.8	29.6	32.0
2011/5/12 21:00	69.2	39.6	29.0	32.5
2011/5/12 22:00	60.4	39.6	28.5	33.0
2011/5/12 23:00	57.6	39.9	27.9	33.0
2011/5/13 0:00	55.2	40.3	27.6	33.5
2011/5/13 1:00	53.2	40.5	27.2	34.0
2011/5/13 2:00	51.5	40.9	27.0	34.5
2011/5/13 3:00	50.0	41.2	26.8	35.0
2011/5/13 4:00	48.6	41.5	26.6	35.0
2011/5/13 5:00	47.4	41.9	26.5	35.5
2011/5/13 6:00	46.3	42.2	26.5	35.5
2011/5/13 7:00	45.5	42.5	26.4	36.0
2011/5/13 8:00	44.5	42.8	26.4	36.5
2011/5/13 9:00	43.3	43.1	26.3	36.5
2011/5/13 10:00	45.0	43.3	26.3	37.0
2011/5/13 11:00	47.4	43.2	26.2	37.0
2011/5/13 12:00	50.0	42.8	26.2	37.5
2011/5/13 13:00	52.3	42.2	26.2	38.0
2011/5/13 14:00	54.9	41.8	26.2	38.0
2011/5/13 15:00	57.1	41.6	26.1	38.5
2011/5/13 16:00	58.7	41.3	26.1	39.0
2011/5/13 17:00	60.9	41.0	26.1	39.0
2011/5/13 18:00	63.0	40.6	26.1	39.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/13 19:00	65.3	40.3	29.7	39.5
2011/5/13 20:00	67.8	40.0	31.8	38.0
2011/5/13 21:00	68.9	39.9	32.8	37.0
2011/5/13 22:00	62.2	39.8	34.5	36.5
2011/5/13 23:00	59.1	40.1	36.7	35.5
2011/5/14 0:00	56.5	40.3	38.2	34.5
2011/5/14 1:00	54.6	40.7	39.6	34.0
2011/5/14 2:00	52.5	41.1	41.1	33.5
2011/5/14 3:00	51.0	41.4	42.4	33.0
2011/5/14 4:00	49.3	41.6	44.2	32.0
2011/5/14 5:00	48.0	42.1	45.9	31.5
2011/5/14 6:00	46.7	42.4	47.8	30.5
2011/5/14 7:00	45.8	42.7	49.5	30.0
2011/5/14 8:00	44.9	43.0	51.0	30.0
2011/5/14 9:00	44.2	43.4	52.7	29.5
2011/5/14 10:00	44.9	43.7	54.1	29.5
2011/5/14 11:00	47.7	43.4	44.6	29.0
2011/5/14 12:00	49.9	43.3	41.8	29.5
2011/5/14 13:00	52.4	42.7	39.1	30.0
2011/5/14 14:00	54.6	42.3	37.0	30.0
2011/5/14 15:00	56.7	41.9	35.4	30.5
2011/5/14 16:00	58.9	41.5	33.8	31.0
2011/5/14 17:00	61.1	41.3	32.5	31.5
2011/5/14 18:00	63.0	41.0	31.6	32.0
2011/5/14 19:00	65.3	40.6	30.7	32.0
2011/5/14 20:00	67.4	40.3	29.9	32.5
2011/5/14 21:00	69.0	40.1	29.4	33.0
2011/5/14 22:00	62.4	40.1	29.0	33.0
2011/5/14 23:00	58.9	40.4	28.5	34.0
2011/5/15 0:00	56.4	40.6	28.2	34.0
2011/5/15 1:00	54.4	41.0	27.9	34.5
2011/5/15 2:00	52.3	41.3	27.7	35.0
2011/5/15 3:00	50.7	41.7	27.4	35.0
2011/5/15 4:00	49.1	41.9	27.3	35.5
2011/5/15 5:00	47.8	42.4	27.1	36.0
2011/5/15 6:00	46.6	42.7	27.0	36.0
2011/5/15 7:00	45.7	42.9	26.9	36.5
2011/5/15 8:00	44.8	43.3	26.8	37.0
2011/5/15 9:00	44.1	43.7	26.7	37.5
2011/5/15 10:00	45.4	43.8	26.6	38.0
2011/5/15 11:00	47.9	43.6	26.6	38.0
2011/5/15 12:00	50.4	43.4	26.6	38.5
2011/5/15 13:00	53.1	42.8	26.6	38.5
2011/5/15 14:00	55.3	42.4	26.5	39.0
2011/5/15 15:00	57.3	42.0	26.6	39.0
2011/5/15 16:00	59.6	41.8	26.6	39.5
2011/5/15 17:00	61.7	41.5	26.6	40.0
2011/5/15 18:00	63.8	41.0	26.7	40.0
2011/5/15 19:00	65.7	40.8	29.8	40.5
2011/5/15 20:00	67.7	40.5	31.2	40.0
2011/5/15 21:00	69.1	40.3	32.6	38.0
2011/5/15 22:00	61.8	40.2	34.6	37.0
2011/5/15 23:00	59.1	40.4	36.6	37.0
2011/5/16 0:00	56.2	40.8	38.2	36.0
2011/5/16 1:00	54.3	41.1	39.3	35.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/16 2:00	52.2	41.4	40.8	34.5
2011/5/16 3:00	50.6	41.7	42.2	34.0
2011/5/16 4:00	49.7	42.1	43.8	33.0
2011/5/16 5:00	47.8	42.4	45.3	32.5
2011/5/16 6:00	46.6	42.7	47.1	32.0
2011/5/16 7:00	45.7	43.1	48.6	31.0
2011/5/16 8:00	45.5	43.4	50.2	30.5
2011/5/16 9:00	43.7	43.7	51.8	30.5
2011/5/16 10:00	45.5	43.6	52.8	30.0
2011/5/16 11:00	48.2	43.3	44.3	30.0
2011/5/16 12:00	50.5	43.3	41.7	30.5
2011/5/16 13:00	54.1	42.5	38.3	31.0
2011/5/16 14:00	55.1	42.3	37.5	31.5
2011/5/16 15:00	57.2	42.0	36.1	32.0
2011/5/16 16:00	59.4	41.7	34.7	32.0
2011/5/16 17:00	61.7	41.4	33.6	32.5
2011/5/16 18:00	63.4	41.2	32.9	33.0
2011/5/16 19:00	65.6	40.8	32.1	33.0
2011/5/16 20:00	67.5	40.6	31.5	33.5
2011/5/16 21:00	69.9	40.4	31.0	34.0
2011/5/16 22:00	62.1	40.5	30.6	34.0
2011/5/16 23:00	59.6	40.7	30.3	34.5
2011/5/17 0:00	56.7	41.0	30.0	35.0
2011/5/17 1:00	54.6	41.4	29.7	35.5
2011/5/17 2:00	53.3	41.8	29.4	36.0
2011/5/17 3:00	51.8	42.1	29.1	36.0
2011/5/17 4:00	49.4	42.3	28.8	36.5
2011/5/17 5:00	48.1	42.6	28.5	36.5
2011/5/17 6:00	46.9	43.0	28.2	37.0
2011/5/17 7:00	45.8	43.5	27.9	37.5
2011/5/17 8:00	44.9	43.7	27.7	37.5
2011/5/17 9:00	44.3	44.0	27.6	38.0
2011/5/17 10:00	44.0	44.0	27.5	38.5
2011/5/17 11:00	48.9	43.9	27.3	38.5
2011/5/17 12:00	51.1	43.7	27.2	39.0
2011/5/17 13:00	53.5	43.0	27.1	39.5
2011/5/17 14:00	55.8	42.5	26.9	39.5
2011/5/17 15:00	57.9	42.3	26.8	40.0
2011/5/17 16:00	60.1	41.8	26.7	40.0
2011/5/17 17:00	62.6	41.4	26.7	40.5
2011/5/17 18:00	65.8	40.7	30.2	40.5
2011/5/17 19:00	66.8	40.6	31.0	40.0
2011/5/17 20:00	67.8	40.5	31.9	39.5
2011/5/17 21:00	69.5	40.3	33.5	38.5
2011/5/17 22:00	61.4	40.3	35.7	37.0
2011/5/17 23:00	59.2	40.5	37.3	36.5
2011/5/18 0:00	56.5	40.8	38.8	35.5
2011/5/18 1:00	54.3	41.1	40.1	35.0
2011/5/18 2:00	52.2	41.6	41.6	34.0
2011/5/18 3:00	50.2	41.9	43.2	33.5
2011/5/18 4:00	49.0	42.2	44.4	33.0
2011/5/18 5:00	47.4	42.5	46.2	32.0
2011/5/18 6:00	46.3	42.8	47.8	31.5
2011/5/18 7:00	45.4	43.2	49.2	31.0
2011/5/18 8:00	44.6	43.5	50.7	30.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/18 9:00	43.7	43.8	52.5	30.0
2011/5/18 10:00	45.2	44.0	53.7	30.0
2011/5/18 11:00	47.8	43.9	46.2	30.0
2011/5/18 12:00	50.4	43.4	41.6	30.5
2011/5/18 13:00	53.0	42.8	39.0	30.5
2011/5/18 14:00	55.4	42.5	36.9	31.0
2011/5/18 15:00	57.4	42.2	35.5	31.5
2011/5/18 16:00	59.9	41.7	33.9	32.0
2011/5/18 17:00	62.0	41.4	32.4	32.5
2011/5/18 18:00	63.8	41.2	31.9	32.5
2011/5/18 19:00	65.8	40.8	31.1	33.0
2011/5/18 20:00	67.3	40.6	30.6	33.5
2011/5/18 21:00	69.0	40.3	30.0	33.5
2011/5/18 22:00	62.1	40.3	29.5	34.0
2011/5/18 23:00	59.0	40.6	29.1	34.0
2011/5/19 0:00	56.4	40.9	28.7	34.5
2011/5/19 1:00	54.2	41.2	28.4	35.0
2011/5/19 2:00	52.3	41.5	28.2	35.5
2011/5/19 3:00	50.4	42.0	27.9	36.0
2011/5/19 4:00	49.1	42.2	27.7	36.5
2011/5/19 5:00	47.6	42.6	27.5	36.5
2011/5/19 6:00	46.6	42.9	27.3	37.0
2011/5/19 7:00	45.2	43.2	27.1	37.0
2011/5/19 8:00	44.6	43.5	27.0	37.5
2011/5/19 9:00	43.9	43.9	26.9	38.0
2011/5/19 10:00	45.9	43.9	26.8	38.0
2011/5/19 11:00	48.4	43.7	26.7	38.5
2011/5/19 12:00	50.9	43.4	26.7	39.0
2011/5/19 13:00	52.9	42.9	26.6	39.5
2011/5/19 14:00	55.3	42.4	26.7	39.5
2011/5/19 15:00	57.7	42.1	26.7	40.0
2011/5/19 16:00	59.9	41.8	26.8	40.0
2011/5/19 17:00	61.8	41.5	26.9	40.5
2011/5/19 18:00	63.7	41.2	26.9	40.5
2011/5/19 19:00	65.4	41.0	30.4	40.5
2011/5/19 20:00	67.5	40.6	32.1	39.5
2011/5/19 21:00	69.3	40.3	33.8	38.0
2011/5/19 22:00	62.4	40.4	35.5	37.5
2011/5/19 23:00	59.5	40.6	37.4	36.5
2011/5/20 0:00	56.9	40.9	39.0	36.0
2011/5/20 1:00	54.6	41.3	40.4	35.0
2011/5/20 2:00	52.4	41.5	41.9	34.0
2011/5/20 3:00	50.5	42.0	43.6	33.5
2011/5/20 4:00	49.2	42.3	44.9	33.0
2011/5/20 5:00	47.8	42.6	46.5	32.0
2011/5/20 6:00	46.6	43.0	48.1	31.5
2011/5/20 7:00	45.7	43.2	49.6	31.0
2011/5/20 8:00	44.7	43.6	51.5	30.5
2011/5/20 9:00	43.1	43.8	52.7	30.0
2011/5/20 10:00	44.6	44.0	54.4	29.5
2011/5/20 11:00	47.6	43.9	46.5	29.5
2011/5/20 12:00	50.0	43.6	43.1	30.0
2011/5/20 13:00	52.6	43.6	40.1	30.5
2011/5/20 14:00	54.7	42.6	37.9	31.0
2011/5/20 15:00	56.7	42.2	36.2	31.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/20 16:00	58.8	41.9	34.6	31.5
2011/5/20 17:00	60.8	41.5	33.3	32.0
2011/5/20 18:00	63.1	41.1	32.1	32.5
2011/5/20 19:00	65.0	40.9	31.1	32.5
2011/5/20 20:00	66.9	40.6	30.4	33.0
2011/5/20 21:00	68.3	40.3	29.8	33.5
2011/5/20 22:00	61.9	40.3	29.2	34.0
2011/5/20 23:00	59.1	40.6	28.8	34.0
2011/5/21 0:00	56.3	40.8	28.4	34.5
2011/5/21 1:00	53.7	41.2	27.9	35.0
2011/5/21 2:00	52.0	41.5	27.6	35.5
2011/5/21 3:00	50.3	41.9	27.3	36.0
2011/5/21 4:00	48.7	42.2	27.1	36.0
2011/5/21 5:00	47.4	42.5	26.9	36.0
2011/5/21 6:00	46.1	42.8	26.7	36.5
2011/5/21 7:00	45.0	43.2	26.5	37.0
2011/5/21 8:00	44.3	43.4	26.4	37.0
2011/5/21 9:00	43.2	43.6	26.2	37.5
2011/5/21 10:00	43.8	44.0	26.2	37.5
2011/5/21 11:00	47.0	43.9	26.2	38.0
2011/5/21 12:00	50.0	43.8	26.2	38.5
2011/5/21 13:00	51.2	43.2	26.2	38.5
2011/5/21 14:00	53.4	42.8	26.2	39.0
2011/5/21 15:00	56.2	42.4	26.2	39.5
2011/5/21 16:00	57.7	42.2	26.2	39.5
2011/5/21 17:00	60.0	41.8	26.3	40.0
2011/5/21 18:00	62.1	41.4	29.9	40.0
2011/5/21 19:00	63.9	41.1	30.8	40.0
2011/5/21 20:00	65.8	40.8	32.5	38.0
2011/5/21 21:00	67.7	40.5	34.2	37.5
2011/5/21 22:00	59.6	40.6	36.1	36.5
2011/5/21 23:00	56.9	40.9	37.9	36.0
2011/5/22 0:00	54.6	41.1	39.3	35.0
2011/5/22 1:00	52.7	41.5	40.7	34.5
2011/5/22 2:00	50.8	41.9	42.1	33.5
2011/5/22 3:00	49.3	42.2	43.5	33.0
2011/5/22 4:00	47.7	42.6	45.3	32.5
2011/5/22 5:00	46.6	42.9	46.8	32.0
2011/5/22 6:00	45.5	43.1	48.4	31.0
2011/5/22 7:00	44.5	43.4	49.9	30.0
2011/5/22 8:00	43.5	44.0	52.0	30.0
2011/5/22 9:00	42.9	44.2	53.0	30.0
2011/5/22 10:00	44.2	44.4	45.6	29.5
2011/5/22 11:00	45.6	44.3	43.6	29.5
2011/5/22 12:00	48.3	44.1	40.6	30.0
2011/5/22 13:00	50.9	43.5	38.0	30.5
2011/5/22 14:00	53.2	43.0	36.1	31.0
2011/5/22 15:00	55.2	42.7	34.6	31.0
2011/5/22 16:00	57.4	42.3	33.3	31.5
2011/5/22 17:00	59.7	41.9	32.0	32.0
2011/5/22 18:00	61.4	41.5	31.1	32.0
2011/5/22 19:00	63.4	41.1	30.3	32.5
2011/5/22 20:00	65.3	40.8	29.6	33.0
2011/5/22 21:00	67.2	40.5	29.0	33.5
2011/5/22 22:00	60.7	40.2	28.5	34.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/22 23:00	56.9	40.6	28.0	34.5
2011/5/23 0:00	54.9	40.9	27.7	34.5
2011/5/23 1:00	52.8	41.1	27.4	35.0
2011/5/23 2:00	50.7	41.5	27.2	35.0
2011/5/23 3:00	49.1	41.9	27.0	35.5
2011/5/23 4:00	47.7	42.1	26.8	36.0
2011/5/23 5:00	46.5	42.5	26.7	36.5
2011/5/23 6:00	45.3	42.8	26.6	36.5
2011/5/23 7:00	44.0	43.4	26.5	37.0
2011/5/23 8:00	43.2	43.7	26.4	37.5
2011/5/23 9:00	42.8	43.7	26.3	38.0
2011/5/23 10:00	44.0	43.9	26.3	38.0
2011/5/23 11:00	46.7	43.7	26.3	38.5
2011/5/23 12:00	49.1	43.5	26.3	39.0
2011/5/23 13:00	51.5	42.9	26.3	39.0
2011/5/23 14:00	53.5	42.5	26.3	39.5
2011/5/23 15:00	56.0	42.1	26.3	39.5
2011/5/23 16:00	58.1	41.8	26.3	40.0
2011/5/23 17:00	60.1	41.4	29.3	40.0
2011/5/23 18:00	62.0	41.1	30.2	40.0
2011/5/23 19:00	64.1	40.7	31.8	40.0
2011/5/23 20:00	66.4	40.4	33.9	38.0
2011/5/23 21:00	67.9	40.2	35.3	37.0
2011/5/23 22:00	61.4	40.1	37.5	36.0
2011/5/23 23:00	58.3	40.4	38.8	35.5
2011/5/24 0:00	55.7	40.7	40.3	35.0
2011/5/24 1:00	53.6	41.0	41.7	34.0
2011/5/24 2:00	51.8	41.3	43.0	33.5
2011/5/24 3:00	50.2	41.6	44.5	33.0
2011/5/24 4:00	48.8	41.9	46.1	32.5
2011/5/24 5:00	47.6	42.2	47.6	32.0
2011/5/24 6:00	46.4	42.5	49.3	31.0
2011/5/24 7:00	45.6	42.8	50.8	30.0
2011/5/24 8:00	44.7	43.1	52.3	30.0
2011/5/24 9:00	44.0	43.6	53.8	29.5
2011/5/24 10:00	45.2	43.7	55.4	29.5
2011/5/24 11:00	47.6	43.5	46.1	30.0
2011/5/24 12:00	50.0	43.3	42.9	30.0
2011/5/24 13:00	52.5	42.7	39.9	30.5
2011/5/24 14:00	54.7	42.3	37.8	31.0
2011/5/24 15:00	57.0	41.9	35.9	31.0
2011/5/24 16:00	59.0	41.7	34.4	31.5
2011/5/24 17:00	60.9	41.4	33.1	32.0
2011/5/24 18:00	62.7	41.1	32.0	32.5
2011/5/24 19:00	64.5	40.8	31.1	33.0
2011/5/24 20:00	66.2	40.5	30.3	33.0
2011/5/24 21:00	68.1	40.3	29.7	33.5
2011/5/24 22:00	61.3	40.3	29.2	34.0
2011/5/24 23:00	58.6	40.6	28.8	34.0
2011/5/25 0:00	55.9	41.1	28.4	34.5
2011/5/25 1:00	54.0	41.4	28.1	35.0
2011/5/25 2:00	52.2	41.7	27.9	35.5
2011/5/25 3:00	50.7	42.0	27.7	36.0
2011/5/25 4:00	49.4	42.3	27.5	36.5
2011/5/25 5:00	48.3	42.6	27.4	36.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/25 6:00	47.0	43.0	27.2	36.5
2011/5/25 7:00	46.2	43.3	27.2	37.0
2011/5/25 8:00	45.4	43.6	27.2	37.5
2011/5/25 9:00	44.8	43.9	27.1	37.5
2011/5/25 10:00	46.1	44.1	27.0	38.0
2011/5/25 11:00	48.2	43.8	26.9	38.5
2011/5/25 12:00	50.6	43.6	26.9	39.0
2011/5/25 13:00	53.8	42.9	26.9	39.5
2011/5/25 14:00	54.8	42.7	26.9	39.5
2011/5/25 15:00	56.9	42.4	26.9	39.5
2011/5/25 16:00	58.7	42.1	26.9	40.0
2011/5/25 17:00	61.0	41.8	26.8	40.0
2011/5/25 18:00	62.7	41.6	26.8	40.5
2011/5/25 19:00	64.7	41.3	31.2	40.5
2011/5/25 20:00	66.8	41.0	32.9	39.5
2011/5/25 21:00	68.7	40.7	34.7	37.5
2011/5/25 22:00	61.5	40.9	36.8	37.0
2011/5/25 23:00	58.9	41.1	38.3	36.0
2011/5/26 0:00	57.5	41.5	39.7	35.0
2011/5/26 1:00	55.6	41.8	41.1	35.0
2011/5/26 2:00	52.8	42.2	42.5	34.0
2011/5/26 3:00	51.2	42.5	43.9	33.5
2011/5/26 4:00	49.8	42.8	45.4	33.0
2011/5/26 5:00	48.6	43.1	47.2	32.0
2011/5/26 6:00	47.4	43.4	48.8	31.5
2011/5/26 7:00	46.4	43.8	50.6	31.0
2011/5/26 8:00	45.7	44.1	51.8	30.5
2011/5/26 9:00	45.0	44.3	53.2	30.0
2011/5/26 10:00	46.0	44.5	47.0	30.0
2011/5/26 11:00	48.2	44.4	44.2	30.5
2011/5/26 12:00	50.6	44.2	41.1	30.5
2011/5/26 13:00	52.8	43.6	38.5	31.0
2011/5/26 14:00	54.8	43.1	36.6	31.5
2011/5/26 15:00	56.9	42.9	34.9	31.5
2011/5/26 16:00	59.0	42.5	33.6	32.0
2011/5/26 17:00	60.6	42.3	32.6	32.5
2011/5/26 18:00	62.8	42.0	31.7	33.0
2011/5/26 19:00	64.9	41.7	30.9	33.5
2011/5/26 20:00	66.9	41.5	30.4	34.0
2011/5/26 21:00	68.7	41.3	30.0	34.0
2011/5/26 22:00	62.7	41.3	29.7	34.5
2011/5/26 23:00	59.7	41.6	29.4	34.5
2011/5/27 0:00	57.4	41.8	29.2	35.0
2011/5/27 1:00	55.3	42.2	29.0	35.5
2011/5/27 2:00	53.4	42.5	28.8	35.5
2011/5/27 3:00	51.5	42.8	28.6	36.0
2011/5/27 4:00	50.0	43.1	28.5	36.0
2011/5/27 5:00	48.8	43.4	28.4	36.5
2011/5/27 6:00	47.7	43.9	28.3	37.0
2011/5/27 7:00	46.5	44.3	28.2	37.5
2011/5/27 8:00	45.8	44.5	28.1	38.0
2011/5/27 9:00	45.2	45.2	28.0	38.5
2011/5/27 10:00	47.2	44.8	28.0	38.5
2011/5/27 11:00	49.2	44.5	27.9	39.0
2011/5/27 12:00	51.4	44.3	27.8	39.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/27 13:00	53.8	43.6	27.7	39.5
2011/5/27 14:00	56.1	43.3	27.6	40.0
2011/5/27 15:00	58.0	43.1	27.5	40.0
2011/5/27 16:00	59.9	42.8	27.3	40.5
2011/5/27 17:00	62.0	42.4	27.3	40.5
2011/5/27 18:00	63.7	42.2	30.0	41.0
2011/5/27 19:00	65.8	41.9	30.9	40.5
2011/5/27 20:00	67.5	41.6	32.2	40.5
2011/5/27 21:00	69.5	41.3	34.1	38.0
2011/5/27 22:00	62.7	41.3	35.6	37.5
2011/5/27 23:00	59.3	41.5	37.9	37.0
2011/5/28 0:00	56.5	41.8	39.2	35.5
2011/5/28 1:00	54.0	42.1	40.7	35.0
2011/5/28 2:00	52.1	42.4	42.0	34.0
2011/5/28 3:00	50.5	42.8	43.4	33.0
2011/5/28 4:00	49.0	43.1	44.8	32.5
2011/5/28 5:00	47.6	43.4	46.4	32.0
2011/5/28 6:00	47.4	43.8	48.0	31.0
2011/5/28 7:00	46.4	44.1	49.7	30.5
2011/5/28 8:00	45.4	44.4	51.4	30.0
2011/5/28 9:00	44.0	44.7	52.8	29.5
2011/5/28 10:00	45.3	44.7	54.5	29.0
2011/5/28 11:00	47.6	44.6	44.1	29.0
2011/5/28 12:00	49.9	44.3	40.7	29.5
2011/5/28 13:00	53.0	43.5	36.8	30.0
2011/5/28 14:00	54.5	43.1	35.2	30.0
2011/5/28 15:00	56.7	42.8	33.1	30.5
2011/5/28 16:00	58.7	42.4	31.6	31.0
2011/5/28 17:00	60.8	42.0	30.3	31.5
2011/5/28 18:00	62.6	41.7	29.3	32.0
2011/5/28 19:00	64.4	41.3	28.5	32.0
2011/5/28 20:00	66.4	41.1	27.7	32.5
2011/5/28 21:00	67.8	41.1	27.2	32.5
2011/5/28 22:00	70.5	41.5	26.7	33.0
2011/5/28 23:00	72.1	41.8	26.3	33.5
2011/5/29 0:00	73.8	42.1	26.0	34.0
2011/5/29 1:00	75.4	42.4	25.7	34.5
2011/5/29 2:00	77.1	42.8	25.5	35.0
2011/5/29 3:00	78.9	43.1	25.3	35.0
2011/5/29 4:00	80.5	43.5	25.1	35.5
2011/5/29 5:00	82.2	43.7	25.0	36.0
2011/5/29 6:00	84.1	44.2	24.9	36.0
2011/5/29 7:00	85.7	44.5	24.9	36.5
2011/5/29 8:00	87.4	44.7	24.7	37.0
2011/5/29 9:00	89.0	45.0	24.7	37.0
2011/5/29 10:00	90.5	45.3	24.7	37.5
2011/5/29 11:00	92.2	45.7	24.6	37.5
2011/5/29 12:00	93.7	46.0	24.6	38.0
2011/5/29 13:00	83.0	46.2	24.6	38.5
2011/5/29 14:00	76.5	46.6	24.5	39.0
2011/5/29 15:00	70.0	46.9	24.5	39.0
2011/5/29 16:00	64.9	47.2	24.5	39.5
2011/5/29 17:00	60.8	47.5	24.5	39.5
2011/5/29 18:00	56.5	47.8	28.0	40.0
2011/5/29 19:00	52.8	48.1	29.0	40.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/5/29 20:00	50.5	48.4	30.2	39.5
2011/5/29 21:00	50.0	48.6	31.7	37.0
2011/5/29 22:00	50.9	48.5	33.4	36.0
2011/5/29 23:00	53.1	48.3	35.2	35.0
2011/5/30 0:00	55.3	47.8	37.1	34.5
2011/5/30 1:00	57.5	46.2	38.4	33.5
2011/5/30 2:00	59.6	45.5	39.8	32.5
2011/5/30 3:00	61.5	45.1	41.1	32.0
2011/5/30 4:00	64.0	44.2	42.7	31.0
2011/5/30 5:00	66.0	43.6	44.1	30.0
2011/5/30 6:00	68.1	42.9	45.8	29.5
2011/5/30 7:00	70.2	42.3	47.4	29.0
2011/5/30 8:00	72.2	41.8	49.0	29.0
2011/5/30 9:00	73.8	41.4	50.2	29.0
2011/5/30 10:00	76.1	40.8	44.7	28.5
2011/5/30 11:00	66.4	40.5	41.4	29.0
2011/5/30 12:00	61.0	40.8	37.8	29.0
2011/5/30 13:00	57.4	41.0	35.6	29.0
2011/5/30 14:00	53.5	41.4	33.2	29.5
2011/5/30 15:00	50.4	41.7	31.5	30.0
2011/5/30 16:00	48.4	42.0	30.5	30.0
2011/5/30 17:00	46.4	42.3	29.6	30.5
2011/5/30 18:00	44.8	42.6	28.9	31.0
2011/5/30 19:00	43.2	42.9	28.3	31.0
2011/5/30 20:00	42.0	43.3	27.9	31.0
2011/5/30 21:00	40.9	43.6	27.5	31.5
2011/5/30 22:00	39.9	44.0	27.2	32.0
2011/5/30 23:00	39.1	44.2	27.0	33.0
2011/5/31 0:00	38.5	44.5	26.8	33.0
2011/5/31 1:00	37.9	44.8	26.6	33.5
2011/5/31 2:00	37.3	45.1	26.5	34.0
2011/5/31 3:00	36.9	45.5	26.4	34.5
2011/5/31 4:00	36.5	45.7	26.4	34.5
2011/5/31 5:00	36.2	46.0	26.3	35.0
2011/5/31 6:00	35.9	46.4	26.3	35.5
2011/5/31 7:00	35.7	46.6	26.3	36.0
2011/5/31 8:00	35.5	46.9	26.3	36.5
2011/5/31 9:00	35.2	47.3	26.3	36.5
2011/5/31 10:00	36.7	47.3	26.3	37.0
2011/5/31 11:00	39.6	47.0	26.3	37.5
2011/5/31 12:00	41.8	46.7	26.3	37.5
2011/5/31 13:00	44.2	45.0	26.3	38.0
2011/5/31 14:00	46.2	44.4	26.3	38.5
2011/5/31 15:00	48.7	43.9	26.4	39.0
2011/5/31 16:00	50.7	43.3	26.4	39.0
2011/5/31 17:00	53.2	42.7	26.4	39.0
2011/5/31 18:00	55.0	42.2	29.3	39.5
2011/5/31 19:00	58.3	41.4	30.6	39.5
2011/5/31 20:00	59.0	41.2	31.1	38.5
2011/5/31 21:00	61.0	40.9	32.6	37.0
2011/5/31 22:00	54.7	40.4	34.3	36.5
2011/5/31 23:00	51.5	40.6	36.6	35.5
2011/6/1 0:00	49.2	40.9	37.9	34.5
2011/6/1 1:00	47.2	41.2	39.1	34.0
2011/6/1 2:00	45.4	41.5	40.5	33.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/1 3:00	43.9	41.9	41.8	33.0
2011/6/1 4:00	42.6	42.1	43.2	32.5
2011/6/1 5:00	41.5	42.4	44.6	32.0
2011/6/1 6:00	40.6	42.8	46.0	31.0
2011/6/1 7:00	39.8	43.1	47.5	31.0
2011/6/1 8:00	39.0	43.5	49.3	30.5
2011/6/1 9:00	38.5	43.7	50.6	30.0
2011/6/1 10:00	39.1	43.9	52.0	30.0
2011/6/1 11:00	42.0	43.7	43.7	30.0
2011/6/1 12:00	44.0	43.5	41.5	30.5
2011/6/1 13:00	46.2	42.7	39.3	30.5
2011/6/1 14:00	48.6	42.0	37.2	31.0
2011/6/1 15:00	51.0	41.6	35.5	31.5
2011/6/1 16:00	52.8	41.3	34.5	32.0
2011/6/1 17:00	55.0	40.8	33.4	32.5
2011/6/1 18:00	56.8	40.4	32.6	32.5
2011/6/1 19:00	58.9	40.0	31.8	33.0
2011/6/1 20:00	60.9	39.6	31.2	33.5
2011/6/1 21:00	62.9	39.2	30.6	33.5
2011/6/1 22:00	55.3	39.1	30.2	34.0
2011/6/1 23:00	52.4	39.4	29.9	34.0
2011/6/2 0:00	49.9	39.8	29.6	35.0
2011/6/2 1:00	47.7	40.1	29.3	35.5
2011/6/2 2:00	46.0	40.4	29.1	35.5
2011/6/2 3:00	44.6	40.7	29.0	36.0
2011/6/2 4:00	43.2	41.0	28.8	36.5
2011/6/2 5:00	42.0	41.3	28.7	36.5
2011/6/2 6:00	41.0	41.7	28.5	37.0
2011/6/2 7:00	40.3	42.0	28.5	37.0
2011/6/2 8:00	39.6	42.3	28.4	37.5
2011/6/2 9:00	39.0	42.6	28.3	38.0
2011/6/2 10:00	40.5	42.7	28.3	38.0
2011/6/2 11:00	42.6	42.6	28.2	38.5
2011/6/2 12:00	44.9	42.3	28.2	39.0
2011/6/2 13:00	47.2	41.4	28.1	39.0
2011/6/2 14:00	49.7	40.9	28.1	39.5
2011/6/2 15:00	51.7	40.6	28.1	39.5
2011/6/2 16:00	53.8	40.3	28.1	40.0
2011/6/2 17:00	56.0	39.9	28.1	40.5
2011/6/2 18:00	57.7	39.6	30.7	40.5
2011/6/2 19:00	59.9	39.2	31.6	40.5
2011/6/2 20:00	61.8	38.9	33.1	40.0
2011/6/2 21:00	63.6	38.6	34.5	38.0
2011/6/2 22:00	58.0	38.6	36.3	37.5
2011/6/2 23:00	52.6	38.1	38.1	37.0
2011/6/3 0:00	50.0	39.1	39.5	36.0
2011/6/3 1:00	47.9	39.5	40.8	35.5
2011/6/3 2:00	46.1	39.7	42.1	35.0
2011/6/3 3:00	44.4	40.1	43.5	34.0
2011/6/3 4:00	43.0	40.5	45.0	33.0
2011/6/3 5:00	42.0	40.8	46.3	32.5
2011/6/3 6:00	40.9	41.1	48.1	32.0
2011/6/3 7:00	40.0	41.4	49.5	31.5
2011/6/3 8:00	39.4	41.6	50.6	31.0
2011/6/3 9:00	38.8	42.1	52.4	30.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/3 10:00	40.0	42.2	53.9	30.0
2011/6/3 11:00	42.0	42.1	46.7	30.5
2011/6/3 12:00	44.3	41.9	43.2	31.0
2011/6/3 13:00	46.7	41.0	40.3	31.0
2011/6/3 14:00	48.8	40.5	38.0	31.5
2011/6/3 15:00	50.8	40.2	36.3	32.0
2011/6/3 16:00	52.7	39.8	34.9	32.0
2011/6/3 17:00	54.8	39.5	33.6	32.5
2011/6/3 18:00	57.0	39.1	32.5	33.0
2011/6/3 19:00	58.9	38.8	31.7	33.0
2011/6/3 20:00	60.6	38.6	31.0	33.5
2011/6/3 21:00	62.6	38.1	30.5	34.0
2011/6/3 22:00	54.8	38.0	30.0	34.5
2011/6/3 23:00	52.0	38.4	29.7	34.5
2011/6/4 0:00	49.6	38.7	29.3	35.0
2011/6/4 1:00	47.6	39.0	29.1	35.5
2011/6/4 2:00	45.8	39.4	29.0	36.0
2011/6/4 3:00	44.3	39.7	28.8	36.5
2011/6/4 4:00	43.0	40.0	28.7	36.5
2011/6/4 5:00	42.0	40.4	28.6	37.0
2011/6/4 6:00	41.1	40.7	28.6	37.5
2011/6/4 7:00	40.4	41.1	28.5	38.0
2011/6/4 8:00	39.7	41.4	28.5	38.0
2011/6/4 9:00	39.2	41.4	28.4	38.5
2011/6/4 10:00	40.7	41.8	28.3	38.5
2011/6/4 11:00	43.3	41.6	28.3	39.0
2011/6/4 12:00	45.7	41.4	28.3	39.0
2011/6/4 13:00	47.8	40.7	28.3	39.5
2011/6/4 14:00	50.1	40.3	28.3	40.0
2011/6/4 15:00	52.1	40.0	28.3	40.0
2011/6/4 16:00	54.3	39.6	28.2	40.0
2011/6/4 17:00	56.3	39.2	28.2	40.5
2011/6/4 18:00	57.9	39.0	30.8	40.5
2011/6/4 19:00	60.3	38.6	31.7	40.5
2011/6/4 20:00	62.1	38.4	33.1	39.5
2011/6/4 21:00	55.6	38.2	34.5	38.5
2011/6/4 22:00	55.2	38.2	36.3	38.0
2011/6/4 23:00	52.3	38.5	38.3	37.0
2011/6/5 0:00	50.1	38.8	39.4	36.5
2011/6/5 1:00	48.0	39.1	40.8	35.5
2011/6/5 2:00	46.1	39.4	42.1	35.0
2011/6/5 3:00	44.5	39.8	43.5	34.5
2011/6/5 4:00	43.2	40.1	44.9	33.5
2011/6/5 5:00	42.0	40.5	46.4	33.0
2011/6/5 6:00	41.0	41.0	48.0	32.5
2011/6/5 7:00	40.2	41.1	49.4	32.0
2011/6/5 8:00	39.6	41.5	50.8	31.0
2011/6/5 9:00	38.9	41.8	52.4	31.0
2011/6/5 10:00	40.9	41.7	53.8	30.5
2011/6/5 11:00	43.2	41.7	48.7	31.0
2011/6/5 12:00	46.1	41.4	41.4	31.5
2011/6/5 13:00	48.1	40.7	39.4	32.0
2011/6/5 14:00	50.0	40.4	37.6	32.0
2011/6/5 15:00	52.1	40.0	35.9	32.5
2011/6/5 16:00	54.3	39.6	34.5	33.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/5 17:00	56.5	39.3	33.2	33.5
2011/6/5 18:00	58.3	38.9	32.3	33.5
2011/6/5 19:00	60.1	38.6	31.5	34.0
2011/6/5 20:00	61.9	38.3	30.9	34.0
2011/6/5 21:00	57.3	38.0	30.3	34.5
2011/6/5 22:00	54.3	38.2	29.8	35.0
2011/6/5 23:00	51.7	38.4	29.5	35.0
2011/6/6 0:00	49.5	38.7	29.2	35.5
2011/6/6 1:00	47.5	39.0	28.9	36.0
2011/6/6 2:00	45.7	39.4	28.7	36.5
2011/6/6 3:00	44.4	39.7	28.5	36.5
2011/6/6 4:00	43.0	40.1	28.4	37.0
2011/6/6 5:00	42.1	40.4	28.2	37.5
2011/6/6 6:00	41.0	40.8	28.1	38.0
2011/6/6 7:00	40.2	41.1	28.1	38.0
2011/6/6 8:00	39.5	41.4	28.0	38.0
2011/6/6 9:00	38.9	41.8	28.0	38.5
2011/6/6 10:00	40.1	41.9	28.0	39.0
2011/6/6 11:00	43.1	41.8	28.0	39.0
2011/6/6 12:00	45.0	41.7	28.1	39.5
2011/6/6 13:00	47.2	40.8	28.1	39.5
2011/6/6 14:00	49.5	40.4	28.2	40.0
2011/6/6 15:00	51.8	40.1	28.2	40.5
2011/6/6 16:00	54.6	39.6	28.4	40.5
2011/6/6 17:00	55.6	39.4	28.4	41.0
2011/6/6 18:00	57.7	39.0	29.5	41.0
2011/6/6 19:00	59.6	38.7	32.5	41.0
2011/6/6 20:00	61.3	38.5	33.6	40.0
2011/6/6 21:00	63.1	38.3	35.2	39.0
2011/6/6 22:00	54.5	38.4	36.8	38.0
2011/6/6 23:00	52.1	38.6	38.6	37.5
2011/6/7 0:00	49.9	38.9	39.9	37.0
2011/6/7 1:00	48.2	39.2	41.1	36.5
2011/6/7 2:00	46.4	39.6	42.5	36.0
2011/6/7 3:00	45.0	39.9	43.8	35.5
2011/6/7 4:00	43.7	40.3	45.4	34.5
2011/6/7 5:00	42.6	40.6	46.8	34.0
2011/6/7 6:00	41.7	41.0	48.4	33.5
2011/6/7 7:00	40.9	41.3	49.9	33.0
2011/6/7 8:00	40.2	41.6	51.3	32.0
2011/6/7 9:00	39.6	42.0	52.8	31.5
2011/6/7 10:00	40.2	42.2	54.1	31.0
2011/6/7 11:00	42.6	42.1	55.5	30.5
2011/6/7 12:00	45.0	42.0	45.4	31.0
2011/6/7 13:00	47.4	41.3	42.5	31.5
2011/6/7 14:00	49.4	40.7	40.3	32.0
2011/6/7 15:00	51.5	40.5	38.5	33.0
2011/6/7 16:00	53.6	40.2	37.0	33.5
2011/6/7 17:00	56.0	39.7	35.4	33.5
2011/6/7 18:00	58.0	39.4	34.3	34.0
2011/6/7 19:00	59.5	39.2	33.5	34.0
2011/6/7 20:00	61.2	38.9	32.7	34.5
2011/6/7 21:00	63.3	38.6	31.8	35.0
2011/6/7 22:00	54.7	38.7	31.2	35.0
2011/6/7 23:00	52.0	38.9	30.6	35.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/8 0:00	50.0	39.2	30.2	36.0
2011/6/8 1:00	48.0	39.6	29.8	36.5
2011/6/8 2:00	46.2	39.9	29.4	36.5
2011/6/8 3:00	44.2	40.2	29.1	37.0
2011/6/8 4:00	43.4	40.6	28.7	37.0
2011/6/8 5:00	42.2	40.9	28.6	37.5
2011/6/8 6:00	41.2	41.3	28.3	37.5
2011/6/8 7:00	40.4	41.5	28.2	38.0
2011/6/8 8:00	39.4	41.9	28.0	38.0
2011/6/8 9:00	39.8	42.3	27.8	38.5
2011/6/8 10:00	42.3	42.6	27.7	39.0
2011/6/8 11:00	43.8	42.8	27.6	39.0
2011/6/8 12:00	46.9	43.3	27.5	39.5
2011/6/8 13:00	48.8	43.3	27.5	40.0
2011/6/8 14:00	50.8	43.3	27.4	40.0
2011/6/8 15:00	52.7	43.1	27.4	40.5
2011/6/8 16:00	54.7	42.3	27.3	40.5
2011/6/8 17:00	56.6	41.8	27.3	40.5
2011/6/8 18:00	58.7	41.5	27.2	41.0
2011/6/8 19:00	60.5	41.2	31.0	41.0
2011/6/8 20:00	62.2	40.8	32.1	41.0
2011/6/8 21:00	64.2	40.4	33.6	39.0
2011/6/8 22:00	56.4	40.3	35.3	38.0
2011/6/8 23:00	53.7	40.5	37.5	37.5
2011/6/9 0:00	51.5	40.9	38.8	36.5
2011/6/9 1:00	49.5	41.2	40.2	36.0
2011/6/9 2:00	47.6	41.6	41.6	35.5
2011/6/9 3:00	46.3	41.9	42.8	35.0
2011/6/9 4:00	45.0	42.2	44.2	34.0
2011/6/9 5:00	44.0	42.5	45.6	33.5
2011/6/9 6:00	43.0	42.8	47.0	33.0
2011/6/9 7:00	42.1	43.1	48.7	32.5
2011/6/9 8:00	41.5	43.4	50.0	32.0
2011/6/9 9:00	40.9	43.7	51.4	31.5
2011/6/9 10:00	40.8	44.0	52.9	31.0
2011/6/9 11:00	44.0	43.9	43.9	31.0
2011/6/9 12:00	46.3	43.7	41.4	31.0
2011/6/9 13:00	48.5	43.1	39.2	32.0
2011/6/9 14:00	50.1	42.7	37.6	32.5
2011/6/9 15:00	52.4	42.3	35.7	32.5
2011/6/9 16:00	54.5	41.9	34.3	33.0
2011/6/9 17:00	56.2	41.6	33.4	33.5
2011/6/9 18:00	58.0	41.3	32.4	34.0
2011/6/9 19:00	60.0	41.0	31.7	34.0
2011/6/9 20:00	62.4	40.6	31.0	34.5
2011/6/9 21:00	64.3	40.4	30.6	35.0
2011/6/9 22:00	56.5	40.3	30.2	35.0
2011/6/9 23:00	54.1	40.5	29.8	35.5
2011/6/10 0:00	51.9	40.8	29.6	36.0
2011/6/10 1:00	50.3	41.2	29.3	36.0
2011/6/10 2:00	48.5	41.6	29.1	36.5
2011/6/10 3:00	47.1	41.9	28.9	37.0
2011/6/10 4:00	46.0	42.2	28.8	37.5
2011/6/10 5:00	44.9	42.5	28.6	37.5
2011/6/10 6:00	44.0	42.9	28.5	38.0

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/10 7:00	43.1	43.2	28.4	38.0
2011/6/10 8:00	42.4	43.5	28.3	38.5
2011/6/10 9:00	41.8	43.8	28.3	39.0
2011/6/10 10:00	41.9	43.9	28.2	39.0
2011/6/10 11:00	43.6	43.8	28.1	39.5
2011/6/10 12:00	46.3	43.5	28.1	40.0
2011/6/10 13:00	49.0	42.8	28.1	40.0
2011/6/10 14:00	51.2	42.5	28.1	40.5
2011/6/10 15:00	53.5	42.2	28.1	40.5
2011/6/10 16:00	55.6	41.9	28.2	41.0
2011/6/10 17:00	57.5	41.6	28.2	41.0
2011/6/10 18:00	59.8	41.3	28.2	41.0
2011/6/10 19:00	62.4	41.0	31.7	41.5
2011/6/10 20:00	64.7	40.6	33.1	41.0
2011/6/10 21:00	55.8	40.3	34.8	39.5
2011/6/10 22:00	57.5	40.5	36.3	38.5
2011/6/10 23:00	55.0	40.7	38.4	37.5
2011/6/11 0:00	52.9	41.0	39.7	37.0
2011/6/11 1:00	50.9	41.4	41.0	36.5
2011/6/11 2:00	49.2	41.7	42.3	36.0
2011/6/11 3:00	47.7	42.0	43.7	35.5
2011/6/11 4:00	46.4	42.3	45.1	34.5
2011/6/11 5:00	45.3	42.6	46.7	33.5
2011/6/11 6:00	44.3	42.9	48.2	33.0
2011/6/11 7:00	43.7	43.3	49.4	32.5
2011/6/11 8:00	42.9	43.6	50.9	32.0
2011/6/11 9:00	42.3	44.0	52.7	32.0
2011/6/11 10:00	42.6	44.1	54.1	31.0
2011/6/11 11:00	45.2	44.0	45.2	31.5
2011/6/11 12:00	47.4	43.8	42.4	32.0
2011/6/11 13:00	49.4	43.1	39.9	32.0
2011/6/11 14:00	51.3	42.8	38.0	32.5
2011/6/11 15:00	53.2	42.4	36.3	33.0
2011/6/11 16:00	55.2	42.1	34.9	33.0
2011/6/11 17:00	56.9	41.8	33.8	33.5
2011/6/11 18:00	59.0	41.5	32.9	34.0
2011/6/11 19:00	61.2	41.2	32.0	34.5
2011/6/11 20:00	63.4	40.9	31.4	35.0
2011/6/11 21:00	66.1	40.5	30.7	35.0
2011/6/11 22:00	56.9	40.7	30.3	35.5
2011/6/11 23:00	54.4	40.9	30.0	36.0
2011/6/12 0:00	52.4	41.2	29.8	36.5
2011/6/12 1:00	50.6	41.5	29.6	36.5
2011/6/12 2:00	48.9	41.8	29.4	37.0
2011/6/12 3:00	47.6	42.2	29.2	37.0
2011/6/12 4:00	46.5	42.4	29.1	37.5
2011/6/12 5:00	45.4	42.9	29.0	38.0
2011/6/12 6:00	44.5	43.2	29.0	38.5
2011/6/12 7:00	43.8	43.5	28.9	39.0
2011/6/12 8:00	43.1	43.8	28.9	39.0
2011/6/12 9:00	42.6	44.1	28.9	39.5
2011/6/12 10:00	43.4	44.2	28.8	39.5
2011/6/12 11:00	45.9	44.1	28.8	39.5
2011/6/12 12:00	48.1	43.9	28.8	40.0
2011/6/12 13:00	50.4	43.3	28.8	40.5

福島第一原子力発電所 5・6号機 原子炉水温度・使用済燃料プール温度

日時	1F5 原子炉水温度	1F5 使用済燃料 プール温度	1F6 原子炉水温度	1F6 使用済燃料 プール温度
2011/6/12 14:00	52.3	42.9	28.7	40.5
2011/6/12 15:00	54.0	42.6	28.7	41.0
2011/6/12 16:00	55.9	42.3	28.7	41.0
2011/6/12 17:00	57.8	41.9	28.7	41.5
2011/6/12 18:00	59.8	41.7	31.4	42.0
2011/6/12 19:00	61.7	41.4	32.2	42.0
2011/6/12 20:00	63.7	41.1	33.7	41.0
2011/6/12 21:00	65.7	40.9	35.3	39.5
2011/6/12 22:00	58.4	40.9	36.9	39.0
2011/6/12 23:00	55.8	41.1	38.9	38.0
2011/6/13 0:00	53.8	41.4	40.1	37.5
2011/6/13 1:00	51.8	41.8	41.6	37.0
2011/6/13 2:00	50.1	42.0	42.9	36.0
2011/6/13 3:00	48.6	42.4	44.3	35.5
2011/6/13 4:00	47.5	42.7	45.6	35.0
2011/6/13 5:00	46.4	43.0	47.1	34.5
2011/6/13 6:00	45.4	43.4	48.7	34.0
2011/6/13 7:00	44.6	43.7	50.2	33.5
2011/6/13 8:00	44.1	44.0	51.5	33.0
2011/6/13 9:00	43.5	44.3	52.9	32.5
2011/6/13 10:00	44.4	44.5	54.5	32.0
2011/6/13 11:00	46.7	44.3	45.5	32.5
2011/6/13 12:00	49.0	44.1	42.6	33.0